


Specialist services
Health Technical Memorandum
08-01: Acoustics

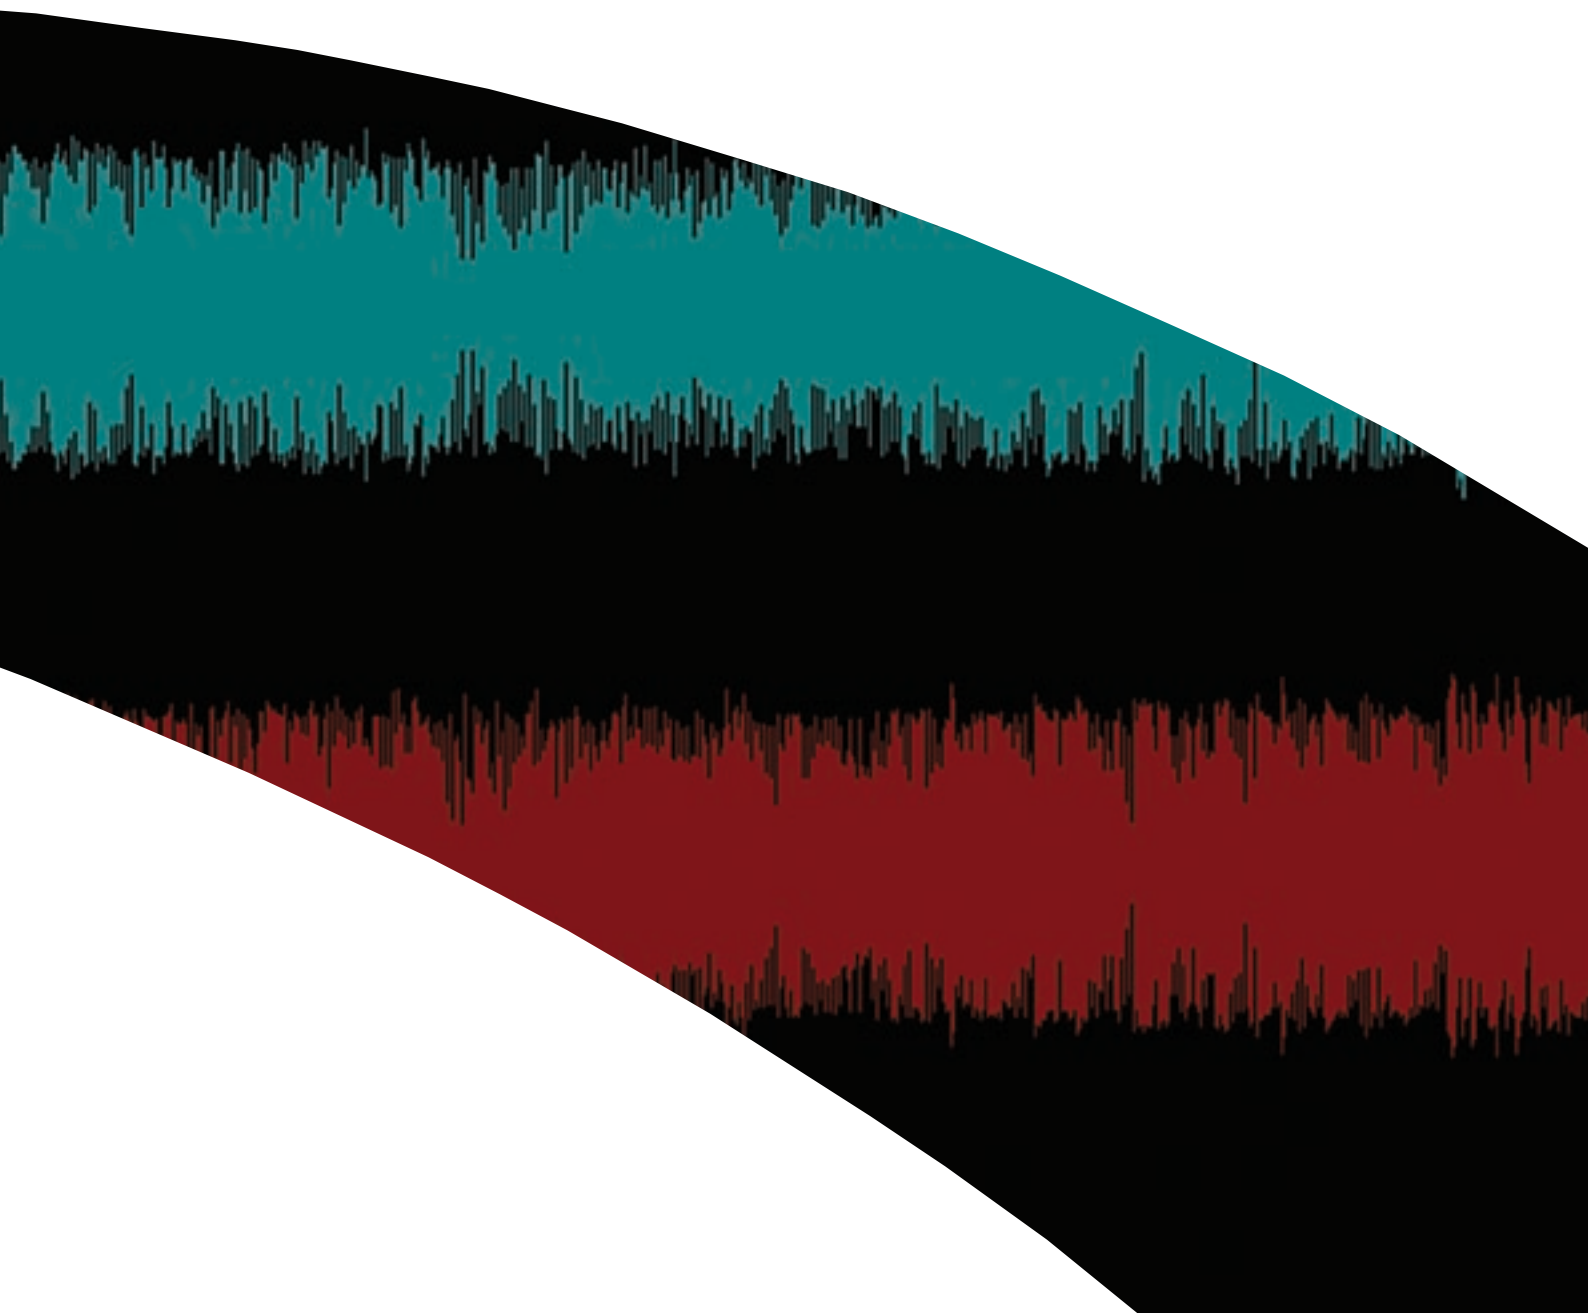

Health Technical Memorandum 08-01: Acoustics

© Crown copyright 2013

This document/publication is not covered by the HMSO Click-Use Licences for core or added-value material. If you wish to re-use this material, please send your application to:

Copyright applications

The Copyright Unit Office of Public Sector Information

Information Policy Team

Kew

Richmond

Surrey TW9 4DU

e-mail: licensing@opsi.gov.uk

Preface

About Health Technical Memoranda

Health Technical Memoranda (HTMs) give comprehensive advice and guidance on the design, installation and operation of specialised building and engineering technology used in the delivery of healthcare.


The focus of Health Technical Memorandum guidance remains on healthcare-specific elements of standards, policies and up-to-date established best practice. They are applicable to new and existing sites, and are for use at various stages during the whole building lifecycle.

main source of specific healthcare-related guidance for estates and facilities professionals.

The core suite of nine subject areas provides access to guidance which:

- is more streamlined and accessible;
- encapsulates the latest standards and best practice in healthcare engineering, technology and sustainability;
- provides a structured reference for healthcare engineering.

Figure 1 Healthcare building life-cycle

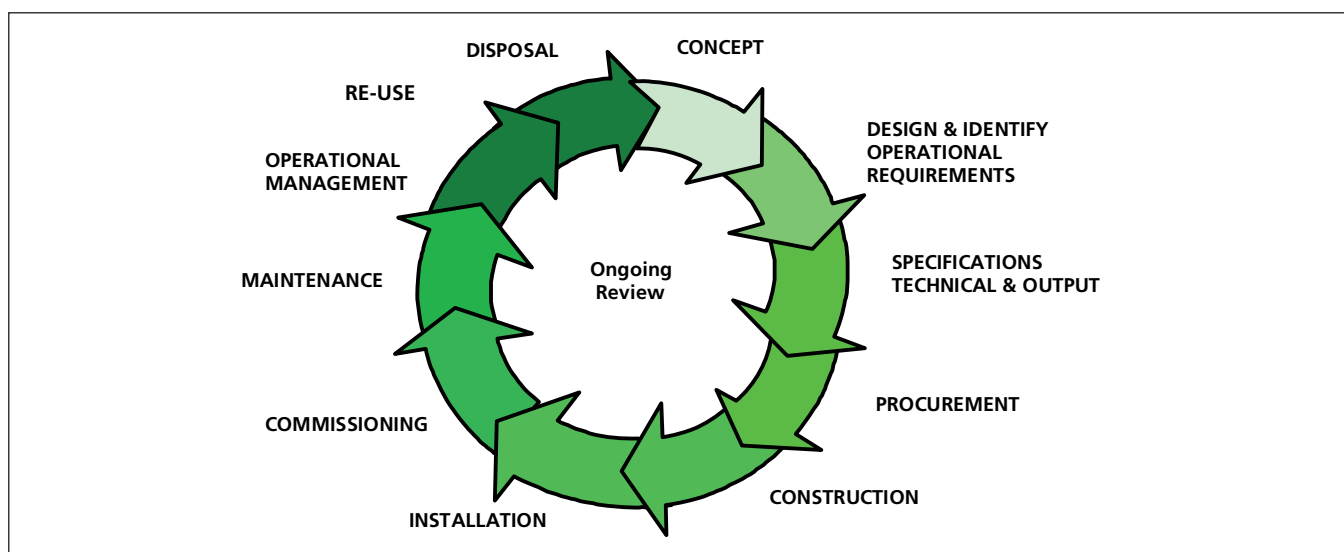

Healthcare providers have a duty of care to ensure that appropriate governance arrangements are in place and are managed effectively. The Health Technical Memorandum series provides best practice engineering standards and policy to enable management of this duty of care.

It is not the intention within this suite of documents to unnecessarily repeat international or European standards, industry standards or UK Government legislation. Where appropriate, these will be referenced.

Healthcare-specific technical engineering guidance is a vital tool in the safe and efficient operation of healthcare facilities. Health Technical Memorandum guidance is the

Structure of the Health Technical Memorandum suite

The series contains a suite of nine core subjects:

Health Technical Memorandum 00

Policies and principles (applicable to all Health Technical Memoranda in this series)

Health Technical Memorandum 01

Decontamination

Health Technical Memorandum 02

Medical gases

Health Technical Memorandum 03
Heating and ventilation systems

Health Technical Memorandum 04
Water systems

Health Technical Memorandum 05
Fire safety

Health Technical Memorandum 06
Electrical services

Health Technical Memorandum 07
Environment and sustainability

Health Technical Memorandum 08
Specialist services

Some subject areas may be further developed into topics shown as -01, -02 etc and further referenced into Parts A, B etc.

Example: Health Technical Memorandum 06-02 represents:

Electrical Services – Electrical safety guidance for low voltage systems

In a similar way Health Technical Memorandum 07-02 represents:

Environment and Sustainability – EnCO₂de.

All Health Technical Memoranda are supported by the initial document Health Technical Memorandum 00 which embraces the management and operational policies from previous documents and explores risk management issues.

Some variation in style and structure is reflected by the topic and approach of the different review working groups.

DH Estates and Facilities Division wishes to acknowledge the contribution made by professional bodies, engineering consultants, healthcare specialists and NHS staff who have contributed to the production of this guidance.

Figure 2 Engineering guidance



Executive summary

This guidance document has been written for healthcare professionals to understand acoustic requirements and to help those involved in the development of healthcare facilities.

Acoustic design is fundamental to the quality of healthcare buildings. Sound affects us both physiologically and psychologically. Noise, which can be defined as “unwanted sound”, can increase heart rate, blood pressure, respiration rate and even blood cholesterol levels. Pleasant sounds help create a sense of well-being. Music can be used to treat depression, to reach autistic people and to calm and relax tense patients.

Good acoustic conditions improve patient privacy and dignity, and promote essential sleep patterns. Such conditions are key to healing. Good acoustic design brings other benefits in terms of patient and staff comfort and morale, as well as improved efficiency and usability of equipment.

This Health Technical Memorandum covers the acoustic design criteria that are important for healthcare premises, and addresses issues such as the provision of temporary healthcare facilities, refurbishments and the control of noise and vibration during construction.

Testing during and after construction, which is essential for quality assurance, is explained.

Chapter 8 includes checklists of the most important acoustic issues that need to be considered in the design of any healthcare facility.

Chapters 9–11 give examples of some of the required calculations.

The document recommends acoustic criteria for:

- noise levels in rooms – both from mechanical services within the building and from noise coming from outside. It is important to create an acoustic environment that allows rooms to be used for resting, sleeping, treatment,

consultation and concentration. There are also statutory limits for noise levels that individuals can be exposed to whilst working;

- external noise levels – noise created by the healthcare building and operation should not unduly affect those that live and work around it;
- sound insulation between rooms – allows rooms to exist side by side. Noisy activities should not interfere with the requirements of adjacent rooms, and private conversations should not be overheard outside the room. The guidance given now allows for raised voices being commonly expected for hearing-impaired patients and staff;
- impact sound insulation – prevents footfall noise of people walking over rooms interfering with the use of rooms below;
- room acoustics – guidance is given on quantities of acoustically-absorbent material to provide a comfortable acoustic environment;
- audio systems – announcements to patients, visitors and staff should be intelligible;
- audiology facilities – without proper acoustic conditions the hearing-test facilities cannot function (see Health Building Note 12-01 Supplement C – ‘ENT and audiology clinics’);
- vibration caused by plant, medical equipment and activities should not affect the use of the building. Some medical equipment is sensitive to vibration, and so are people.

This document supersedes all other guidance by the Department of Health on acoustics.

Acknowledgements

The working group members and main contributors to Health Technical Memorandum 08-01 were:

Richard Budd, Sound Research Laboratories Limited

Chris Holme, Department of Health, Estates & Facilities

Nick Boulter, Arup Acoustics

David Rowley, Nightingale Associates

Tim Redmore, Sharps Redmore Partnership

David Howe, Zisman Bowyer & Partners

Peter Hammond, HPC King's College Hospital

Paul Freeborn, Bureau Veritas

Tim Spencer, Rockfon Ltd

Jason Bassett, Lafarge

Peter Young, Arup Consulting Engineers

Steve Hicks, Steel Construction Institute

Comments were received from the following bodies:

Adnitt Acoustics

Apex Acoustics

Arup Acoustics

BRE

Bureau Veritas

Eckel Noise Control Technologies

IAC Limited

Institute of Acoustics

Leaderflush & Shapland (LS Group)

NHS Wales

Nightingale Associates

Rockfon Limited

Sound Research Laboratories Limited

Steel Construction Institute

Walker Beak Mason

Zisman Bowyer & Partners

Contents

Preface	
Executive summary	
Acknowledgements	
1 Introduction	1
2 Acoustic criteria	2
Agreeing the criteria for each project	
Internal noise levels from external sources	
Pre-design noise survey	
Noise intrusion	
Sporadic events	
Rain noise	
Internal noise from mechanical and electrical services	
Normal operating conditions	
Medical equipment	
Emergency plant	
Materials	
Pneumatic tube systems	
Nurse-call systems	
Plantrooms	
Services and sound insulation	
External noise levels	
Internal sound insulation	
Sound insulation for rooms	
Long-term accommodation	
Doors	
Openable windows	
Movable/folding partitions	
Structure-borne sound and lightweight constructions	
Controlling background sound	
Sound-flanking paths	
Height of partitions	
Bathroom pods	
Impact sound insulation	
Room acoustics	
Audio systems for public announcements	
Audiology facilities	
Vibration	
Continuous vibration	
Intermittent vibration	
Vibration-sensitive equipment	
3 Construction noise and vibration	18
4 Temporary healthcare facilities	19
5 Refurbished accommodation	20
6 Inspecting works during construction	21

7 Testing and validation	22
Sound insulation	
Noise levels generated by mechanical and electrical services	
Intrusive noise	
Audio system intelligibility	
Environmental noise	
Audiometric testing rooms	
General comments	
Failure to meet criteria	
Commissioning results	
8 Checklists	25
9 Partition and floor sound insulation	27
Example 1. Lightweight partition – absorbent ceilings	
Example 2. Concrete floor – absorbent ceilings	
Example 3. Lightweight partition – non-absorbent ceilings	
Example 4. Lightweight partition – absorbent ceilings – different room uses	
Example 5. Lightweight partition – absorbent ceilings – small non-sensitive room	
10 Calculation of equivalent absorption area	33
Method A	
Method B	
11 Worked examples of vibration performance criteria	34
12 Glossary	35
13 References	37
Acts and regulations	
British, European and International Standards	
Department of Health publications	
Other publications	

1 Introduction

This Health Technical Memorandum has been written for healthcare professionals to understand acoustic requirements and to help those involved in the development of healthcare facilities.

It sets out acoustic criteria for the design and management of new healthcare facilities. The Health Technical Memorandum does not give solutions to meet the acoustic criteria; designers on each individual project should develop these.

A specialist acoustic adviser should be used to take a holistic approach to the acoustic design. Therefore detailed acoustic theory is not included in this Health Technical Memorandum, although sufficient detail is given for a basic understanding of the acoustic issues. It would be unwise to design a healthcare development without specialist acoustic advice right from the outline design stage.

Acoustic design is fundamental to the quality of healthcare buildings. Sound affects us both physiologically and psychologically. Noise, which can be defined as “unwanted sound”, can increase heart rate, blood pressure, respiration rate and even blood cholesterol levels. Pleasant sounds help create a sense of well-being. Music can be used to treat depression, to reach autistic people and to calm and relax tense patients.

Good acoustic conditions improve patient privacy and dignity, and promote essential sleep patterns. Such conditions are key to healing. Good acoustic design brings other benefits in terms of patient and staff comfort and morale, as well as improved efficiency and usability of equipment.

2 Acoustic criteria

Agreeing the criteria for each project

- 2.1 It is important to set appropriate acoustic design criteria for healthcare premises. This document sets out the minimum recommended criteria. Each development has special features, and these criteria may not be appropriate for all projects.
- 2.2 A statement of acoustic criteria should be prepared for each project. This will set out the acoustic requirements and the particular acoustic issues that affect the development. The presumption will be that these criteria will equate to those listed in this document. The onus will be on designers to identify whether the acoustic criteria given can be achieved and to set out an argument for changing them.
- 2.3 The parameters to be considered include:
 - equivalent continuous sound pressure level (L_{Aeq});
 - noise rating (NR) curves;
 - vibration dose value (VDV);
 - weighted standardised level difference ($D_{nT,w}$);
 - weighted standardised impact sound pressure level ($L'_{nT,w}$);
 - room acoustics; and
 - speech transmission index (STI).
- 2.4 Noise criteria for mechanical services should be specified in terms of an NR value for each area under consideration. Appropriate values are quoted for various locations.
- 2.5 Sound insulation of external façades depends on external noise levels and how quiet the rooms inside need to be. Appropriate noise levels in rooms are recommended.
- 2.6 Sound insulation of internal partitions is linked to the degree of privacy that is necessary, and the need to reduce noise from other rooms. The increasing implications of the loss of privacy on the NHS have also been considered. Therefore acoustic

requirements are included to allow for the raised speech that a hearing-impaired person could experience. It is, however, impractical to design internal sound insulation to achieve full speech privacy if shouts and screams occur.

Internal noise levels from external sources

Pre-design noise survey

- 2.7 The design should include decisions on the layout of the site to optimise acoustic performance.
- 2.8 Usually, noise should be measured at site before starting the design. Ambient noise levels will be needed in the design process. Vibration measurements may also be needed (for example where the site is near a railway line or when there is equipment sensitive to vibration).
- 2.9 As a minimum, the survey should cover highest daytime noise (and vibration) levels. As the facilities and associated plant usually operate at night, the night-time lowest noise levels will also need to be measured.
- 2.10 A Competent Person (see Appendix D) should carry out the noise measurements at appropriate locations and times.
- 2.11 The design should be based upon noise levels that take account of anticipated changes on and around the site. For example, if the site will attract more road traffic, the increase in noise level should be predicted and added to measured levels. Changes in road traffic caused by other factors (such as natural growth in road traffic, other new developments etc) should also be included as far as reasonably practicable.
- 2.12 Noise produced by any buildings that are to be retained, and the effect of the new development on them, should be evaluated.
- 2.13 The noise levels on site may dictate ventilation strategy, space planning, building shape and layout.

Noise intrusion

2.14 Table 1 sets out recommended criteria for noise intrusion for the completed building (including normal furniture).

Table 1 Criteria for noise intrusion from external sources

Room type	Example	Criteria for noise intrusion to be met inside the spaces from external sources (dB)
Ward – single person	Single-bed ward, single-bed recovery areas and on-call room, relatives' overnight stay	40 $L_{Aeq, 1hr}$ daytime 35 $L_{Aeq, 1hr}$ night 45 $L_{Amax, f}$ night
Ward – multi-bed	Multi-bed wards, recovery areas	45 $L_{Aeq, 1hr}$ daytime 35 $L_{Aeq, 1hr}$ night 45 $L_{Amax, f}$ night
Small office-type spaces	Private offices, small treatment rooms, interview rooms, consulting rooms	40 $L_{Aeq, 1hr}$
Open clinical areas	A&E	45 $L_{Aeq, 1hr}$
Circulation spaces	Corridors, hospital street, atria	55 $L_{Aeq, 1hr}$
Public areas	Dining areas, waiting areas, playrooms	50 $L_{Aeq, 1hr}$
Personal hygiene (en-suite)	Toilets, showers	45 $L_{Aeq, 1hr}$
Personal hygiene (public and staff)	Toilets, showers	55 $L_{Aeq, 1hr}$
Small food-preparation areas	Ward kitchens	50 $L_{Aeq, 1hr}$
Large food-preparation areas	Main kitchens	55 $L_{Aeq, 1hr}$
Large meeting rooms (>35 m² floor area)	Lecture theatres, meeting rooms, board rooms, seminar rooms, classrooms	35 $L_{Aeq, 1hr}$
Small meeting rooms (≤35 m² floor area)	Meeting rooms, seminar rooms, classrooms, board rooms	40 $L_{Aeq, 1hr}$
Operating theatres	Operating theatres	40 $L_{Aeq, 1hr}$ 50 $L_{Amax, f}$
Laboratories	Laboratories	45 $L_{Aeq, 1hr}$

Notes:

Night is defined as the hours between 23.00 and 07.00.

A $L_{Amax, f}$ limit for short-term events is included for sleeping areas and operating theatres. The intention is that this should apply to events that occur several times during the night (for example passing trains) rather than sporadic events (see paragraphs 2.15–2.17).

Where windows have trickle vents, the criteria would normally apply with the windows closed but trickle vents open. If natural ventilation is provided by means other than trickle vents, the acoustic criteria are to be achieved while the required amount of ventilation is supplied.

To achieve the acoustic criteria on noisy sites, acoustically treated trickle vents or mechanical ventilation may be required. Sealed façades may be necessary for the noisiest sites. The acoustic adviser should liaise with the services designer to establish what constitutes the required amount of ventilation, the size of trickle vents, and the acoustic implications of natural ventilation.

Noise from a service yard and other similar activities should be designed not to disturb noise-sensitive accommodation or noise-sensitive receptors outside the site. Where possible, the service yard should be kept away from accommodation, and canopies and other acoustic screening methods should be considered. Without these, it is unlikely that noise-sensitive rooms overlooking a service yard can use trickle vents or openable windows for ventilation. A sealed façade and mechanical ventilation are therefore likely to be required in these locations.

The intrusive noise criteria do not include plant noise from adjacent hospital buildings. This should be considered as mechanical-service noise (see paragraphs 2.23–2.46).

Sporadic events

- 2.15 Hospitals are often affected by noisy but sporadic events such as vehicle sirens, helicopters and aircraft. Each source has to be considered separately and an appropriate strategy devised.
- 2.16 A policy of no sirens on site (unless essential) is recommended.
- 2.17 It is unlikely that the criteria in **Table 1** will be achievable with helicopter movements included, so helicopters may cause some disturbance. Careful planning of the hospital layout and flight path can, however, reduce the effects of helicopter noise.

Rain noise

- 2.18 Rain noise should not result in undue disturbance in internal spaces. Some noise from rain is acceptable in most types of room, and indeed can be comforting to occupants.

- 2.19 Indoor ambient-noise levels during “heavy”¹ rainfall should not exceed the intrusive noise criteria in Table 1 by more than 20 dB(A) or should not be more than 65 dB(A), whichever is lower.
- 2.20 Suitable lightweight roof constructions that provide sufficient attenuation will probably consist of many layers.
- 2.21 Laboratory-measured data is needed to assess the noise level that will result inside the building. Calculations of the expected noise level based on the laboratory test data will normally be sufficient to prove the performance.
- 2.22 Ideally, noise from rainwater pipes within the building needs to meet the service-noise criteria given in Table 2 under “moderate”¹ rainfall conditions. Some acoustic treatment to internal pipework may be required.

1 “Moderate” and “heavy” rainfall is as described in BS EN ISO 140-18

Table 2 Criteria for internal noise from mechanical and electrical services

Area type	Example	Noise from mechanical and electrical services
Ward areas, sleeping areas	Single-bed ward, multi-bed ward, on-call rooms, relatives’ overnight stay Recovery rooms	NR 30 NR 35
Small office-type spaces	Private offices, treatment rooms, interview rooms, consulting rooms	NR 35
Open clinical areas	A&E	NR 40
Circulation spaces	Corridors, hospital street, atria	NR 40
Public areas	Waiting areas, dining, playroom	NR 40
Personal hygiene (en-suite)	Toilets, showers	NR 40
Personal hygiene (general access)	Toilets, showers	NR 45
Small food-preparation areas	Ward kitchens	NR 40
Large food-preparation areas	Main kitchens	NR 50 (NR 55 below extract hoods)
Large meeting rooms (>35 m ² floor area)	Lecture theatres, meeting rooms, seminar rooms, board rooms, classrooms	NR 30
Small meeting rooms (≤35 m ² floor area)	Meeting rooms, seminar rooms, board rooms, classrooms	NR 35
Operating theatres (excluding laminar-flow theatres)	Operating theatres	NR 40
Laminar-flow theatres	Ultra-clean theatre	NR 50
Laboratories		NR 40 when laboratory has no fume cupboards NR 60 at 1 m from fume cupboards with open sash
Utility rooms	Clean utility, dirty utility	NR 40

Internal noise from mechanical and electrical services

Normal operating conditions

- 2.23 The criteria in Table 2 refer to the total noise from mechanical and electrical services (including rainwater pipes draining under “moderate” rainfall conditions, noise from plantrooms and from plant areas in other parts of the building or site), excluding medical equipment. The noise rating (NR) should take account of the noise in the octave band range from 63 Hz to 4 kHz.
- 2.24 The limits are defined in terms of L_{90} and are to be achieved in the completed building (including normal furniture). For design purposes, it can be assumed that the L_{eq} of plant noise is the same value as the L_{90} for continuously operating plant. Noise generated by services should be steady, with no periodic change in noise level or character.
- 2.25 Continuous sound generated by services can provide useful masking noise for public areas. It is therefore not advisable to over-attenuate service-noise in these areas.

Medical equipment

- 2.26 The criteria in Table 2 do not include values for medical equipment. Such equipment is usually procured and installed separately to the other services. The noise from medical equipment should be considered when it is selected. Ideally, it should be chosen so that it does not adversely affect the use of its surrounding space.
- 2.27 Quiet equipment should be chosen.
- 2.28 In sleeping areas, intermittent noise or increased background noise levels can disturb sleep. In other areas (for example X-ray rooms), small increases in noise caused by medical equipment may be acceptable.
- 2.29 Whether any increase above the background levels in Table 2 is acceptable can only be established on a case-by-case basis.

Emergency plant

- 2.30 An increase in internal and external noise levels of up to 10 dB(A) over the noise criteria is normally considered acceptable, provided regular testing only takes place during the daytime on a weekday.
- 2.31 Audible alarms need to be sufficiently noisy to attract the attention of the relevant people.

Materials

- 2.32 Where clinically necessary, acoustic treatments to control noise generated by mechanical and electrical services should incorporate bagged and sealed acoustic media.

Pneumatic tube systems

- 2.33 Noise breakout from pneumatic tube transport systems should be assessed, and pipes routed carefully to avoid sensitive spaces. Some acoustic treatments may be required.

Nurse-call systems

- 2.34 Nurse-call systems can disrupt sleep; therefore non-audible systems should be considered, especially at night. The most appropriate systems should be selected for each project.
- 2.35 Audible alarms intended for staff should be located such that they cause minimum disruption to patients (see Health Technical Memorandum 08-03 – ‘Bedhead services’ for further guidance on nurse-call systems).

Plantrooms

- 2.36 Noise levels in plantrooms should allow normal maintenance without the need for ear protection. This means that selection of quiet versions of plant and/or noise control packages (including enclosures) should be given high priority. The Control of Noise at Work Regulations 2005 require noise levels to be reduced as far as reasonably practicable.
- 2.37 If it is not reasonably practicable to reduce noise levels below the limits where hearing protection is required (for example generator plantrooms), appropriate warning signs, training, procedures to enforce the wearing of hearing protection etc must be provided as indicated in the current legislation.
- 2.38 Reducing noise in plantrooms also benefits by reducing the sound-insulation requirements of the building structure.
- 2.39 Major items of plant, such as generators, chillers, boilers, and combined heat and power (CHP) systems (which may all be in an energy centre), should be as remote as possible from the hospital accommodation. Otherwise significant noise control will be needed on noisy plant. Note, however, that the need for noise control may be driven by environmental noise limits (see paragraphs 2.47–2.49).

Services and sound insulation

- 2.40 The installation of services can dramatically affect sound insulation. Air-transfer grilles are a major cause of acoustic weakness, as are poorly sealed penetrations, common ducts etc. Architects, service engineers and acoustic designers should ensure that the layout of services is appropriate and that their installation does not downgrade acoustic performance.
- 2.41 Crosstalk attenuation is likely to be required in ducted ventilation systems that link rooms requiring sound insulation. The sound-insulation criteria between rooms (see Table 5) should apply to noise transfer via all routes – including ducts.
- 2.42 Sockets, switches, medical-gas outlets, integrated plumbing system (IPS) panels etc should not be back-to-back in partitions intended to provide sound insulation.
- 2.43 High-performance partitions may also need to incorporate acoustic backing boxes on sockets. Stood-off IPS panels and surface-fixed sockets and switches are preferable from an acoustic perspective.
- 2.44 WC cisterns and wastes, hand-wash basin wastes etc should not be mounted within the cavity of lightweight partitions where the partition separates a bathroom from a “medium” or “sensitive” noise-sensitivity room (see Table 3), except for an en-suite serving its own single bedroom.
- 2.45 Bathroom pods need to incorporate sufficient sound insulation to meet the criteria in paragraphs 2.50–2.71. If they are to be installed back-to-back, it is preferable to install imperforate, acoustically-rated partitions between pods. This might affect construction sequences and space planning. Otherwise this means considering the envelope of the pod, especially the roof, where there are often penetrations. Access to the roof to install sound-insulating material is difficult on site.
- 2.46 Where a bathroom pod is a part of a single bedroom, it should be considered an integral part of the bedroom and should provide the same sound insulation to other rooms as a single bedroom (see paragraphs 2.50–2.71).

External noise levels

- 2.47 Noise from healthcare premises can affect properties outside the site. This should be considered when stipulating environmental noise criteria for the project. These external criteria

should be agreed with the local authority and should include any differences allowed for emergency equipment.

- 2.48 The following provisions should apply, with the most stringent taking precedence:
- Noise levels at the site boundary should meet reasonable standards required by the local authority or other relevant body.
 - Noise outside the buildings should be controlled to allow the internal noise criteria to be achieved (with windows or trickle vents open for ventilation if the space is naturally ventilated).
 - Open external areas should be protected. Noise from services should not exceed the existing daytime background noise level or 50 dB L_{A90} , whichever is the higher. This limit should be achieved in any areas normally occupied by staff (except maintenance staff, notwithstanding the requirements of the Control of Noise at Work Regulations 2005) or the public (for example open courtyards and accessible landscaped areas). This means that noisy plantrooms should not face normally occupied external areas unless adequate acoustic control is provided.
- 2.49 A relaxation of acoustic criteria for emergency situations and sporadic events (for example standby generators and helicopter flights) can be considered. This is subject to agreement by the local authority or other relevant body.

Internal sound insulation

Sound insulation for rooms

- 2.50 Appropriate sound insulation needs to be set for each room. Noisy activities should not interfere with the need for quiet in adjacent rooms.
- 2.51 Private conversations should not be overheard. The right to privacy for hearing-impaired patients and staff has been taken into account.
- 2.52 This document therefore takes into account the noise from raised voices, which is commonly expected in a healthcare environment.
- 2.53 Acoustic requirements for partitions and floors are set out in Tables 3 and 4. Table 3 gives the privacy of a source room, anticipated levels of noise generation and the sensitivity of the spaces. For “partition” also read “floor”.

- 2.54 Table 4 is then used to select the standard of sound insulation required based on these parameters in terms of the weighted standardised level difference ($D_{nT,w}$). This parameter is measured on site.
- 2.55 The sound-insulation requirement is assessed between a pair of rooms in each direction (room A to room B and room B to room A) using the privacy requirement for the source room, the noise generation of the source room and the noise sensitivity of the receiving room (see Table 4). Examples of how to calculate this are given in Appendix A.
- 2.56 Manufacturers of building materials provide data for their products in terms of the weighted sound reduction index (R_w), which is measured in a laboratory. The required partition R_w needs to be calculated (using the equations in paragraph 2.61) in each direction and the higher R_w rating used for selecting the partition from manufacturers' data. The R_w is normally higher than the on-site $D_{nT,w}$ figure, and this difference can be significant.
- 2.57 If a specific room type is not listed, the sound-insulation requirements can be derived. The performance required will depend on the privacy requirement and level of noise generation in the source room, and the sensitivity of the receiving room.
- 2.58 The criteria in Table 4 are for the overall installed performance in terms of $D_{nT,w}$ taking account of all sound-transfer paths. To achieve these standards, partitions need a laboratory performance (R_w) significantly higher than the site performance stipulated in the table (see Appendix A). Construction details and quality of workmanship are vitally important to achieve an on-site sound-insulation performance. Sound-flanking up, over and around partitions and floors (including penetrations) should not prevent the requirements being achieved (see paragraphs 2.94–2.98).
- 2.59 For lightweight partitions and floors, R_w should normally be at least 5 dB higher than $D_{nT,w}$, even if flanking is very well-controlled. It is recommended that the difference between R_w and $D_{nT,w}$ is assumed to be at least 7 dB, to allow for many common construction/services details. The equations in paragraph 2.61 assume this 7 dB difference.
- 2.60 For masonry walls and concrete floors, the difference between R_w and $D_{nT,w}$ is more likely to be 4 dB, providing gaps between blocks are fully filled.
- 2.61 An additional allowance should also be made for the room dimensions and the area of the separating wall/floor.
- a. To calculate the R_w required to meet a given $D_{nT,w}$, the following relationships should be used:
- (i) For lightweight walls/floors:
- $$R_w \equiv D_{nT,w} + 10 \log (S/V) + 14.$$
- (ii) For masonry walls/floors:
- $$R_w \equiv D_{nT,w} + 10 \log (S/V) + 11.$$
- Where:
- S = common area of separating element being considered (m^2).
- V = volume of receiving room (m^3).
- b. For cuboid-shaped receiving rooms, where the separating element is the whole of one surface, this can be simplified to:
- (i) For lightweight walls/floors:
- $$R_w \equiv D_{nT,w} - 10 \log d + 14.$$
- (ii) For masonry walls/floors:
- $$R_w \equiv D_{nT,w} - 10 \log d + 11.$$
- Where:
- d = dimension of receiving room perpendicular to separating element being considered (height of room for floor, width or depth of room for partitions, depending on which is perpendicular to the partition being considered).

Note

\equiv means “is equivalent to”.

- 2.62 The figures given in Table 3 and Table 4 are for typical room types. Special constructions to control flanking sound are likely to be required if a performance of $D_{nT,w}$ 52 dB and above is required. Layout planning should therefore avoid adjacencies where $D_{nT,w}$ 52 dB and above is needed.
- 2.63 If a receiving room does not have the minimum absorption area as per paragraphs 2.105–2.114, 3 dB should be added to the values in Table 4 and Table 5.

Table 3 Sound-insulation parameters of rooms

Room	Privacy requirements for source room	Noise generation of the source room	Noise sensitivity of receiving room
Clinical areas			
Single-bed/on-call room	Confidential	Typical	Medium
Multi-bed room	Moderate	Typical	Medium
Children & older people (single bed)	Private	High	Medium
Children & older people (multi-bed)	Moderate	High	Medium
Consulting room	Confidential	Typical	Medium
Examination room	Confidential	Typical	Medium
Treatment room	Confidential	Typical	Medium
Counselling/bereavement room	Confidential	High	Medium
Interview room	Confidential	Typical	Medium
Operating theatre suite	Private	Typical	Sensitive
Nurseries	Moderate	Very high	Medium
Birthing room	Private	Very high	Medium
Laboratories	Moderate	Typical	Medium
Dirty utility/sluice	Not Private	High	Not sensitive
Clean utility	Not Private	Low	Not sensitive
Speech and language therapy	Confidential	High	Sensitive
Snorezen/multi-sensory room	Confidential	High	Sensitive
Public areas			
Multi-faith/chapel	Private	High	Sensitive
Corridor (no door)	Not private	Typical	Not sensitive
Atrium	Not private	High	Not sensitive
Dining	Not private	High	Not sensitive
Toilets (not cubicles)	Moderate	Typical	Not sensitive
Waiting (large >20 people)	Not private	High	Not sensitive
Waiting (small ≤20 people)	Not private	Typical	Not sensitive
Staff areas			
Toilets (not cubicles)	Moderate	Typical	Not sensitive
Main kitchen	Not private	Very high	Not sensitive
Ward kitchen, pantry	Not private	Typical	Not Sensitive
Storeroom	Not private	Low	Not sensitive
Rest room	Moderate	High	Medium
Locker/changing room	Moderate	Typical	Not sensitive
Large training/seminar (>35 m ²)	Private	High	Medium
Small training/seminar (≤35 m ²)	Private	Typical	Medium
Lecture theatre	Private	High	Sensitive
Library/archiving room	Moderate	Low	Sensitive
Single-person office	Private	Typical	Medium
Multi-person office (2–4 people)	Moderate	Typical	Medium
Open-plan office (≥5 people)	Not private	Typical	Medium
Boardroom	Confidential	High	Medium
Large meeting room (>35 m ²)	Private	High	Medium
Small meeting room (≤35 m ²)	Private	Typical	Medium

Table 4 Sound-insulation ratings (dB $D_{nT,w}$) to be achieved on site

Privacy requirement for source room	Noise generation of the source room	Noise sensitivity of receiving room		
		Not sensitive	Medium sensitivity	Sensitive
Confidential	Very high	47	52	★
	High	47	47	52
	Typical	47	47	47
	Low	42	42	47
Private	Very high	47	52	★
	High	42	47	52
	Typical	42	42	47
	Low	37	42	42
Moderate	Very high	47	52	★
	High	37	42	47
	Typical	37	37	42
	Low	No rating	No rating	37
Not private	Very high	47	52	★
	High	No rating	42	47
	Typical	No rating	No rating	42
	Low	No rating	No rating	37

Notes:

★ = These adjacencies should be avoided by layout planning. Where this is not possible, $D_{nT,w}$ 57 dB needs to be achieved as a minimum. In practice this is extremely difficult, as it would need very wide partitions and place onerous demands on the building structure to control flanking noise sufficiently.

Note that for:

Confidential – raised speech would be audible but not intelligible, and normal speech would be inaudible.

Private – normal speech would be audible but not intelligible.

Moderate – normal speech would be audible and intelligible but not intrusive.

Not private – normal speech would be clearly audible and intelligible.

Sensitive – room cannot accommodate any noticeable noise from rooms next door.

Medium sensitivity – room generally needs to be free from noise of other rooms.

Not sensitive – noise from other rooms does not affect the use of the receiving room.

2.64 Raised voices are to be reasonably expected in rooms where medical consultation takes place.

2.65 For everyone to retain adequate privacy (including those with hearing impairment), bedrooms, consulting rooms, examination rooms and treatment rooms have been classed “confidential”. Raised speech would be audible but not intelligible in adjacent rooms.

2.66 A door in a partition will significantly downgrade the partition’s performance. There is no benefit in specifying a partition performance with an R_w that is more than 10 dB higher than the R_w of the doorset within it. As a typical doorset will have an

R_w of 30–35 dB, this means that where there is a door, there is no acoustic benefit in providing partitions with an R_w higher than 40–45 dB, unless especially high performance doorsets or lobbied doors are used. Requirements for doors are covered in paragraphs 2.72–2.86.

2.67 Where observation windows are included between adjacent rooms, partitions (including the glass) should ideally achieve the target ratings given in Tables 4 and 5. However, it can be difficult to fit windows that meet the full acoustic specification into the width of partitions. In this case, as a minimum, the glazing configuration alone should achieve an R_w that is no more than 10 dB below

that of the required R_w for the partition alone. This will reduce the sound insulation by an amount that depends on the size of the observation window in relation to the size of the partition.

- 2.68 If a reduction in sound insulation is likely to cause operational difficulties (for example where a sleep-study observation room is separated from the bedroom by a partition with a large window), the appropriate level of sound insulation should be decided, depending on the circumstances.
- 2.69 This does not apply to windows next to doors or in corridor walls that have doors, where the glazing does not normally need to perform to this extent (due to the reduction in overall sound insulation caused by the doorset). See paragraphs 2.72–2.86.
- 2.70 A summary matrix of key areas is given in [Table 5](#). The data in Table 5 shows the installed sound-insulation performance ($D_{nT,w}$) required. For guidance on indicative laboratory performance ratings (R_w) to achieve these, see [Chapter 9](#).

Long-term accommodation

- 2.71 Spaces used for patients' long-term living and sleeping (for example residential areas of mental health units and residential care homes) should be designed to meet the sound-insulation criteria for "rooms for residential purposes" as defined in Approved Document E of the Building Regulations.

Doors

- 2.72 Doors are inevitably a weakness in a partition and will reduce the overall acoustic performance of most constructions.
- 2.73 Reasonable acoustic performance cannot be achieved without seals around the whole door perimeter, including threshold and meeting stiles. It is recognised that there can be significant restrictions on the use of door seals; therefore, doors should be sealed as far as practically possible.
- 2.74 Possible conflicts with the desired acoustic performance include opening force (including under emergency conditions), infection control, patient safety (for example if double-swing doors are required) and ventilation regimes. Designers should make an informed decision about the provision of door seals when the other restrictions are considered.

Examples of design conflicts to be considered

- The infection control team should be consulted to ascertain whether there is a conflict between the need for seals and the infection control regime.
 - Doors that need to swing both ways (for example on rooms that must have anti-barricade properties) should be considered to find out whether they can accommodate effective acoustic seals.
 - The possibility of using attenuated "up-and-over" duct links above the ceiling, instead of having gaps under doors, should be considered.
 - Acoustically-effective seals on meeting stiles need to be either "wiper blade" or compression seals. With some seals, the door may need an opening force that is not consistent with accessibility regulations. Power-assisted doors may be required if these needs cannot be reconciled.
 - Compression seals require a rebate on the door and thus a door coordinator device, which may cause operational difficulties.
 - The most appropriate type of threshold seals are likely to be drop-down or wiper-blade seals (which would mean that doors need appropriate hinges), because a raised threshold strip fitted to the floor is likely to cause serious operational difficulties (for example trolley traffic, trip hazards etc).
- 2.75 Solid-core door blanks (minimum 21 kg/m²) should be used for access from corridors, and these are capable of achieving an acoustic performance in the range R_w 30–35 dB. If seals can be accommodated, the entire doorset is capable of achieving this level of sound insulation. If seals are not to be provided, the overall performance of the doorset will be in the range R_w 20–25 dB.
- 2.76 Doorsets should be designed so that air gaps between the door blank and the frame are closed (for example by using stops on the door frame).
- 2.77 The type of door used for non-sensitive rooms such as storerooms is not acoustically important.
- 2.78 Where doors have glazed vision panels, these should not reduce the sound insulation of the

doorset (after taking account of the seals that may be applied around the door).

- 2.79 Even if doors can be sealed on all edges, it is still likely that a determined eavesdropper could overhear conversations when the background noise level outside the room is low and/or the room's occupants are talking in raised voices.
- 2.80 If it is determined that seals to all edges will not be provided, it should be recognised that sound insulation and speech privacy will be reduced further. For this reason, "private" or "confidential" (see Table 3) rooms should not be located near areas where there are likely to be people who could overhear. Careful space planning is required to avoid, for example, waiting areas close to doors of consulting rooms or private offices. Sound-masking could also be considered to improve the level of privacy (see paragraphs 2.92–2.93).
- 2.81 Similarly, rooms with "high" or "very high" noise generation should not be located too near to rooms that are classed as "sensitive" or "medium sensitivity" (see Table 3).
- 2.82 The construction of doors and edge detailing also needs to be considered to achieve the required sound insulation between rooms.
- 2.83 Interconnecting doors between consulting rooms should be discouraged on acoustic grounds. The sound insulation will be degraded and speech privacy will not be sufficient.
- 2.84 Doors to "confidential" or "private" rooms should be located as far apart as possible, and not directly opposite each other.
- 2.85 Doors should be fitted with soft-action closers when located in noise-sensitive areas such as speech and language therapy, audiology (see Health Building Note 12-01, Supplement C – 'Audiology'), and mental health accommodation, as well as general ward, consulting and treatment areas.
- 2.86 If acoustic doorsets with a high rating are used, it may be difficult for a person in the room to hear someone knocking on the door. An intercom may be required for such a room if people regularly need to enter whilst it is in use.

Openable windows

- 2.87 Open windows can affect room-to-room sound insulation and lead to privacy problems if external areas are accessible by staff and patients. The

design should take account of this so that privacy is achieved. Access to external areas close to openable windows in private areas may therefore need to be controlled.

- 2.88 Care should also be taken to reduce the risk of sound transfer between spaces by direct reflections off open windows (see Figure 1).

Movable/folding partitions

- 2.89 Movable/folding partitions may be beneficial for operational reasons, but the acoustic performance of these partitions is limited. They are not recommended where speech privacy is required and/or where it will not be acceptable to have any noise disturbance from one room to another.


Structure-borne sound and lightweight constructions

- 2.90 Activities may result in significant structure-borne sound being transferred to the wall surface (for example showers, toilets, kitchens, workshops). If lightweight constructions are used around these spaces in sensitive locations, the transfer of structure-borne noise should be controlled. This may include the use of twin stud frames, resilient board mountings, or spacing the source of impact away from the wall.
- 2.91 Resilient fixings may be necessary for pipework fixed to lightweight partitions. For example, rainwater pipes and WC waste pipes should not be rigidly fixed.

Controlling background sound

- 2.92 Background sound levels affect privacy. Where speech privacy is important, high-quality electronic sound-masking systems should be considered. These require careful commissioning to work effectively. A reduction in the required level of sound insulation of up to 5 dB would be appropriate for spaces where such systems are in use, subject to local agreement. A radio or TV can be used to similar effect, although the degree of control possible is lower.
- 2.93 Sound-masking could be considered for:
- open-plan clinical areas (for example A&E, multi-cubicle treatment rooms);
 - multi-bed wards (should have easily adjustable volume for daytime and night-time operation, which can be controlled centrally);

Figure 1 Reflected sound from openable windows

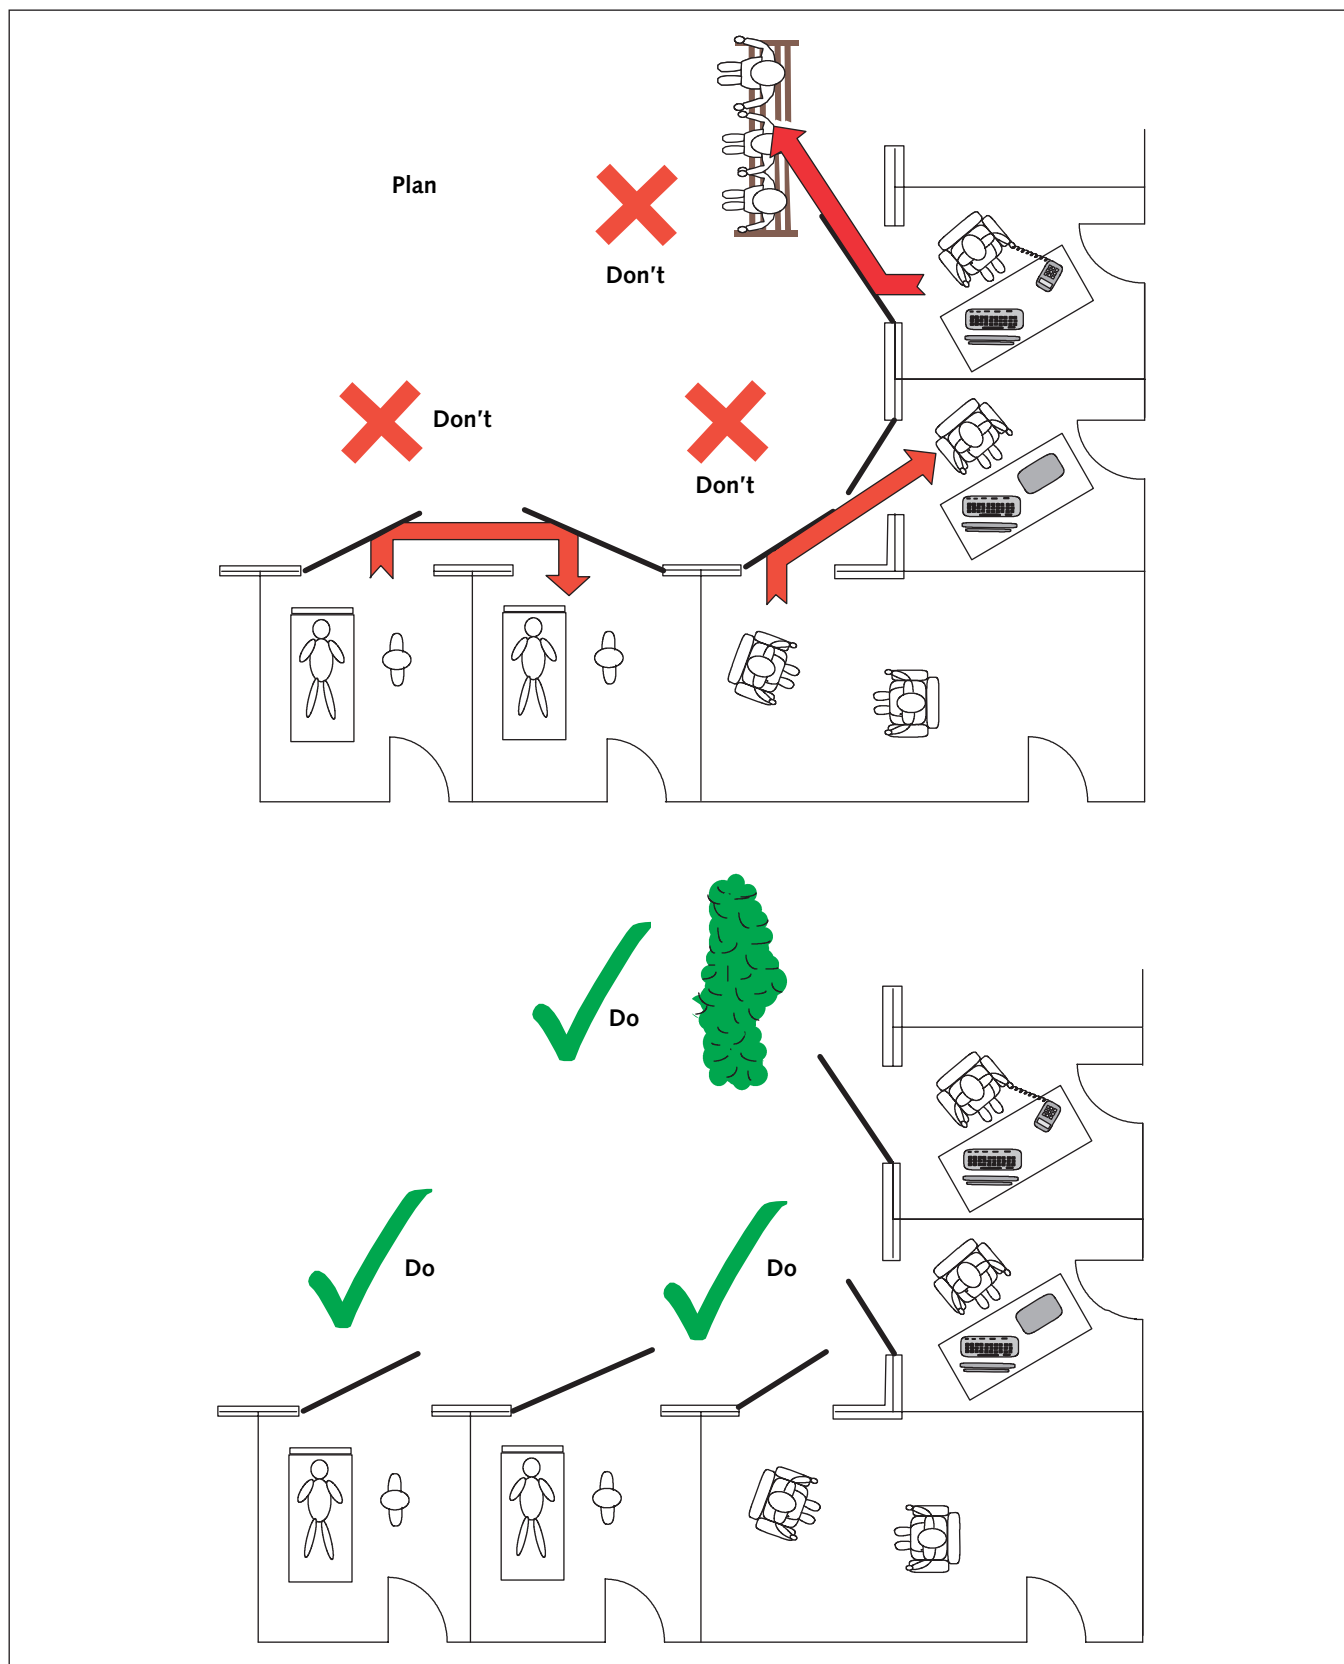


- waiting areas;
- office areas;
- consulting and examination rooms;
- areas close to birthing rooms (no down-rating of the partition should be used in this case as very high sound levels are often generated in birthing rooms);
- rooms in very quiet sites or areas where intrusive noise levels are low.

Sound-flanking paths

- 2.94 Sound-flanking around partitions should be controlled so that sound-insulation requirements between rooms can be met. Vertical and horizontal flanking routes should be considered, including the effect of junction details on the overall sound insulation between spaces. Junctions of acoustic partitions with other walls are common potential weaknesses because of flanking sound transfer along the inner skin.
- 2.95 Similar problems can occur with external walls, particularly where partitions and floors abut glazing/curtain walling. The internal lining to a lightweight external wall should not be continuous across an acoustic partition or floor. Ribbon or shared windows or full-height glazing cause particular problems and are not recommended for “private” or “confidential” privacy rooms and/or

Figure 2 Schematic of partition meeting cladding panel

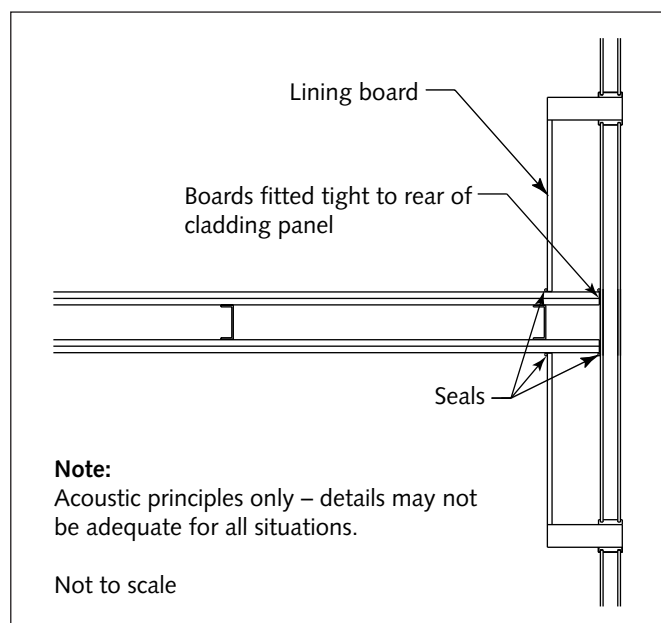

“high” or “very high noise” generation rooms (see Figures 2–5).

- 2.96 Crosstalk attenuation is likely to be required where ducts connect “private”, “confidential” or “sensitive” rooms. Crosstalk attenuation may be provided by proprietary attenuators in the ducts or internally-lined acoustic flexible duct. The amount of crosstalk attenuation required can be reduced by incorporating bends in the duct connecting the grilles, remembering that too many bends will cause pressure drops, and bends which are too tight will cause regenerated noise (see Figures 6–9).

Figure 3 Typical schematic detail at junction of acoustic partitions with corridor walls (preferred)

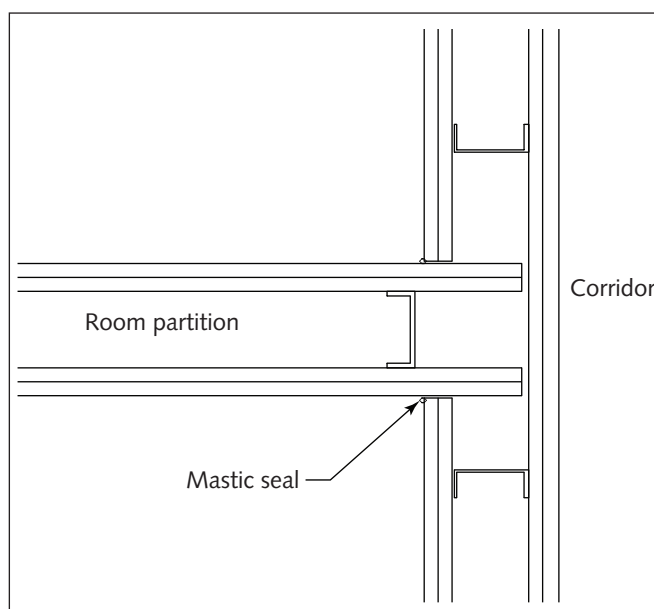


Figure 4 Typical schematic detail at junction of acoustic partitions with corridor walls (alternative)

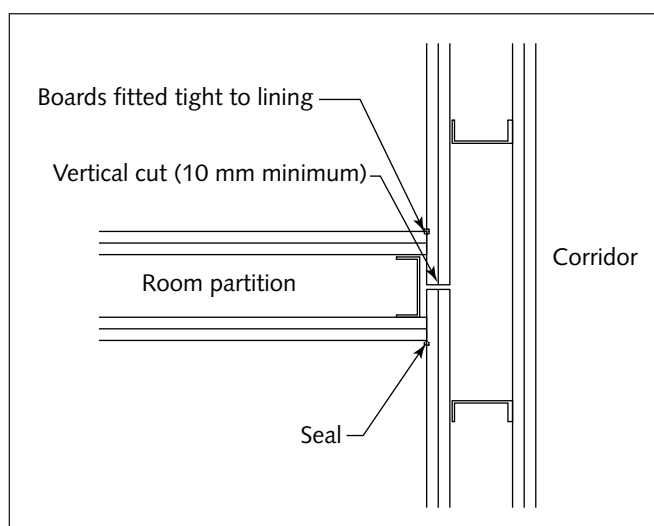
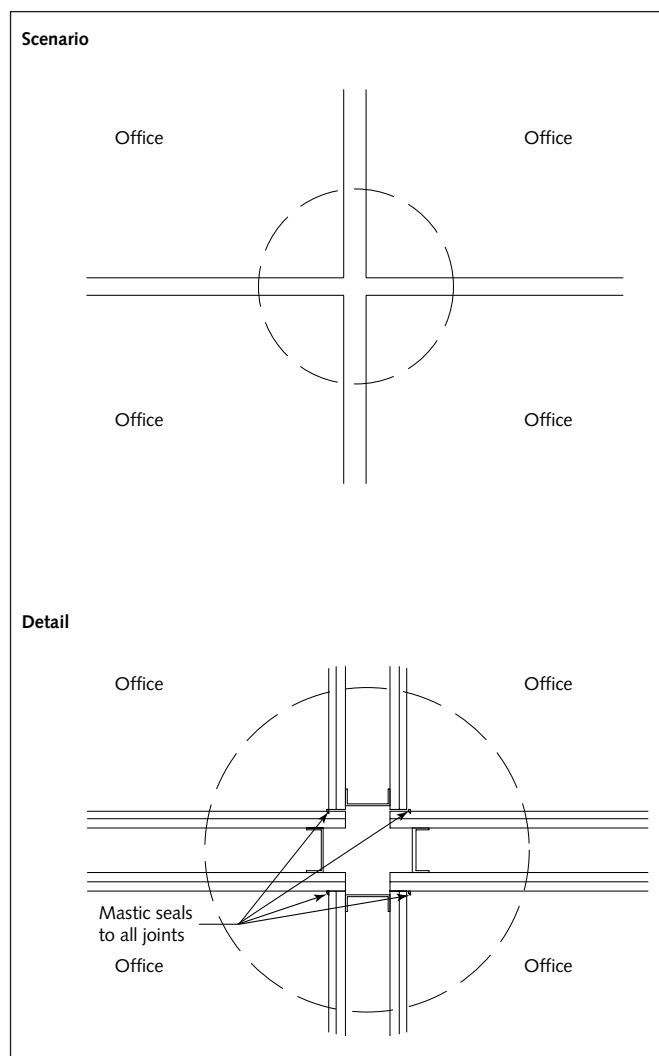


Figure 5 Typical schematic detail at junction of four acoustic partitions

2.97 The junction at the head of partitions should be carefully sealed. Particular care is required where the slab is profiled.

2.98 Service penetrations (for example power sockets) and IPS panels can also significantly degrade the

sound insulation of a partition, particularly where these are back-to-back. In many cases, the sound insulation required cannot be achieved with back-to-back services (see also [paragraphs 2.40–2.46](#)).

Height of partitions

2.99 For optimum performance, an acoustic partition should extend from slab to soffit (of the floor slab/roof above). If a raised access floor is required, the partition should ideally extend through the floor to the slab below. However, with careful acoustic design and material selection, the partition can be built off a raised floor. This is likely to achieve only the lower levels of sound insulation given in [Table 4](#).

2.100 Similarly, if the partition extends only just beyond the ceiling, careful acoustic detailing will be necessary. The ceiling should give sufficient sound insulation (for example solid plasterboard). If under a lightweight roof, the partition should be fixed to a solid underlining, again giving sufficient sound insulation.

Bathroom pods

2.101 Sound insulation between bathroom pods can be significantly reduced by poor designs. For more information, see [paragraphs 2.40–2.46](#).

Impact sound insulation

2.102 Impact noise should be controlled at source wherever possible. Healthcare planning should separate heavily trafficked corridors from sensitive spaces such as wards.

2.103 Wards should not be under heavily-trafficked corridors. If this is unavoidable, impact isolation treatments should be provided.

2.104 A weighted standardised impact sound pressure level ($L'_{nT,w}$) of 65 dB is considered a reasonable

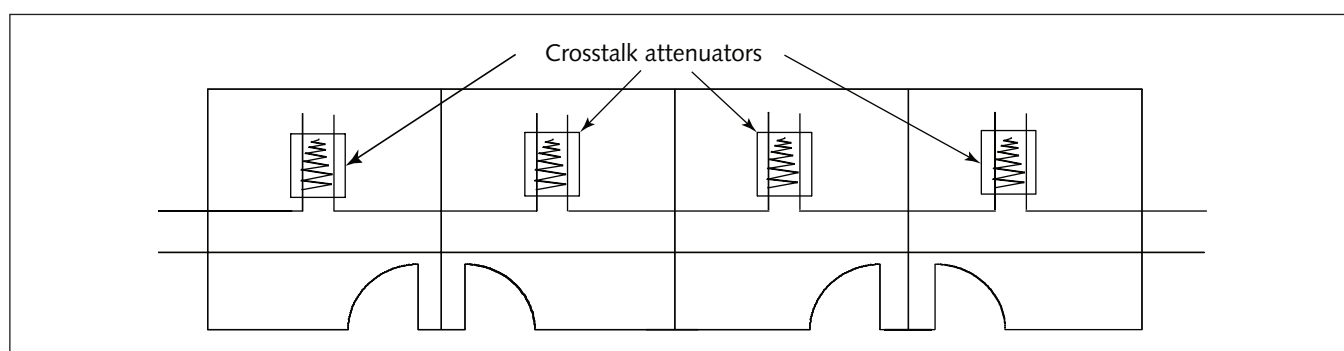
Figure 6 Typical room layout with main duct penetrating acoustic partitions

Figure 7 Typical room layout with main duct in corridor


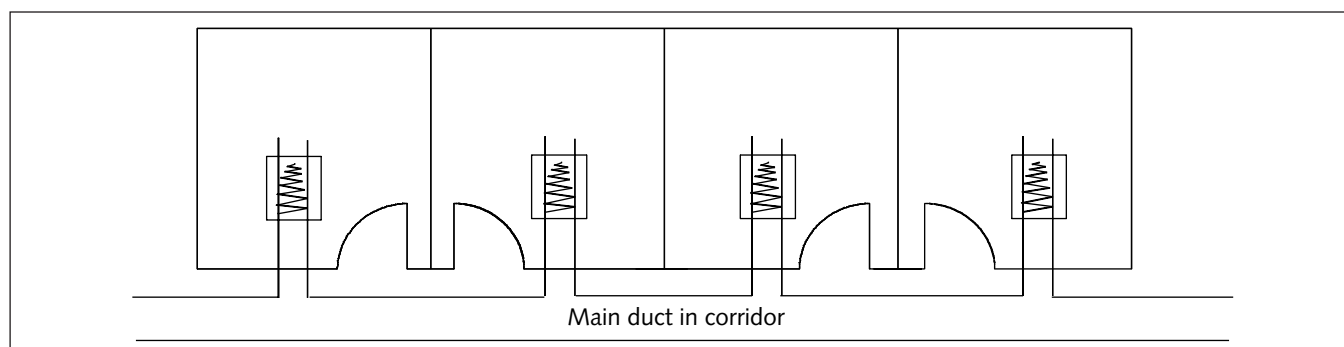


Figure 8 Typical room layout with rooms both sides of corridor duct

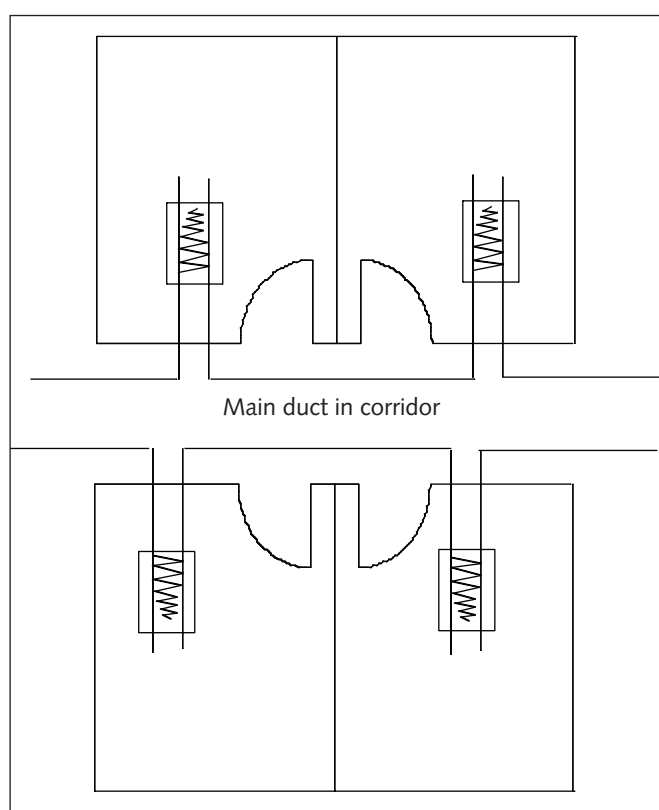


maximum value for floors over noise-sensitive areas. Individual situations that may require extra impact sound insulation should also be considered (for example floors over multi-sensory/Snoezelen rooms).

Room acoustics

- 2.105** Appropriate acoustic treatments can have a dramatic effect on the acoustic comfort in a room. However, the treatments have to be used with care because of the potential implications of infection control, cleaning, impact damage etc.
- 2.106** Sound-absorbent treatment should be provided in all areas (including all corridors), except acoustically unimportant rooms (for example storerooms etc), where cleaning, infection-control, patient-safety, clinical and maintenance requirements allow.
- 2.107** The absorbent treatment will normally be a ceiling. However, floor finishes (for example carpet) or wall panels may also be considered.
- 2.108** Washable, acoustically-absorbent materials will be required in some areas within the infection-control regime.

Figure 9 Layout showing attenuators in series – not recommended

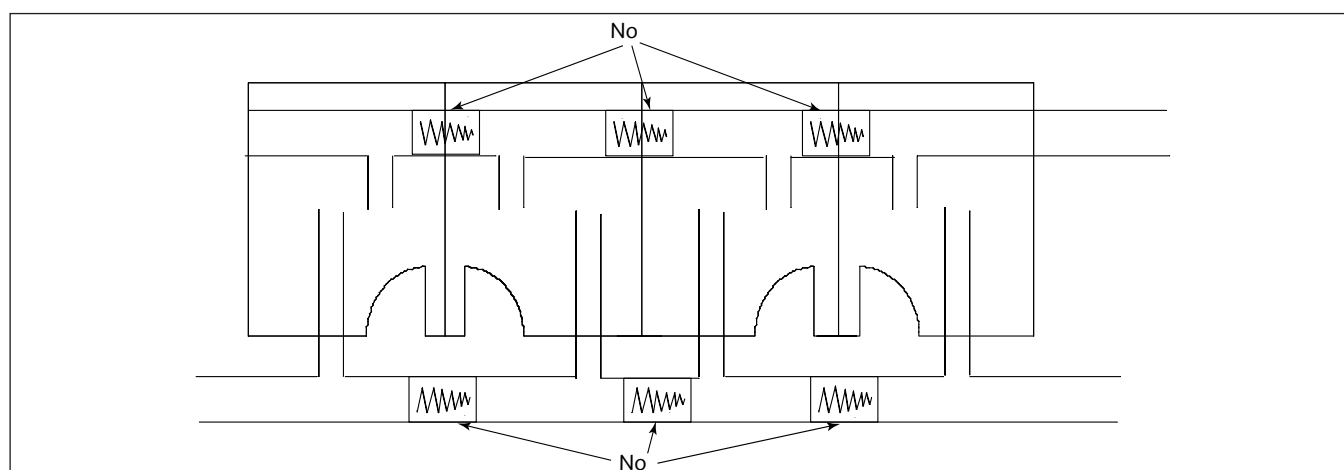

- 2.109 Acoustic treatments are likely to be needed where speech intelligibility is a requirement.
- 2.110 Acoustically-absorbent materials should have a minimum absorption area equivalent to a Class C absorber (as defined in BS EN ISO 11654:1997) covering at least 80% of the area of the floor, in addition to the absorption that may be provided by the building materials normally used. If a Class A or B absorbent material is used, less surface area is needed. (See [Chapter 10](#) for an example of how to calculate the absorption area required for materials with different absorption class.)
- 2.111 For rooms requiring optimum acoustic conditions (such as lecture theatres), specialist advice should be sought.
- 2.112 Acoustic absorption is likely to be needed in large open spaces such as atria, particularly in localised areas within it (for example reception areas and cafeterias). A reverberation-time criterion should be agreed depending on the specific requirements for use of the space.
- 2.113 Absorption can take the form of acoustically-absorbent ceiling tiles, perforated boards (for example timber or plaster), acoustic panels fixed to walls or hung from above, soft floor coverings, soft furnishings etc. However, requirements related to fire safety (for example reaction to fire, fire resistance, smoke emissions etc) should be considered.
- 2.114 The need for public address and voice alarm systems to be intelligible may put extra acoustic requirements on the room (see paragraphs 2.115–2.119).

Audio systems for public announcements

- 2.115 Audio systems should meet a minimum STI of 0.5 or equivalent standard.
- 2.116 The intelligibility should be assessed to BS EN 60268-16 using measurements made at a representative range of evenly spaced locations in relevant spaces.
- 2.117 The audibility and intelligibility of alarms and public address (PA) announcements in noisy or partitioned areas should be assessed, and additional sounders/loudspeakers provided so that messages are audible and intelligible.
- 2.118 In areas where acoustically-absorbent materials cannot be used, adequate intelligibility may be difficult to achieve. Therefore a public address

system may not be appropriate for emergency announcements, and other indicators may be necessary. This may also apply in areas with high noise levels (for example plantrooms) or with particularly high standards of sound insulation (for example audiology booths). The needs of people with hearing impairment should also be considered when designing alarm systems.

- 2.119 Additional requirements will apply for systems that are intended for emergency use as set out in IEC 60849.

Audiology facilities

- 2.120 The acoustic performance of hearing-test rooms within audiology facilities is critical to their clinical performance. Individual test rooms need to be very quiet, at the same time as other hearing-test rooms in the department may create very high noise levels. The rooms should have carefully controlled room acoustics.
- 2.121 Health Building Note 12 Supplement 3 recommends detailed acoustic criteria for audiological testing rooms, and should be referred to.
- 2.122 For parts of the audiology department that are not covered by Health Building Note 12 Supplement 3, the advice within this document applies.

Vibration

- 2.123 Vibration caused by plant, medical equipment and activities within the building should not affect the use of the building. Some medical equipment is sensitive to vibration, and so are people. Excessive vibration can lead to adverse comment from the building occupants and can impair the operation of sensitive equipment.
- 2.124 A competent structural engineer should design the building structure and floors so that the criteria in [paragraphs 2.128–2.134](#) are achieved. The criteria have a low probability of adverse comment with respect to human comfort. They have been shown to be adequate for medical equipment commonly used in wards and treatment rooms.
- 2.125 Requirements for particularly sensitive equipment are considered in [paragraphs 2.135–2.137](#).
- 2.126 Plant vibration should be assessed in conjunction with the structural vibration characteristics in order to meet the vibration criteria. Structure-borne noise from plant also needs to be designed

so that mechanical-service noise limits (Table 2) are met.

- 2.127 Worked examples of vibration assessment are given in Chapter 11.

Continuous vibration

- 2.128 Continuous vibration should be assessed in terms of the root mean square (RMS) value (averaged over one second) of the frequency-weighted acceleration on the floors of occupied areas.
- 2.129 The frequency weighting should be W_g as specified in BS 6841.
- 2.130 The base value of frequency-weighted acceleration is 0.005 m s^{-2} .
- 2.131 Multiplying factors relative to the specified base values are found by dividing the weighted RMS acceleration by the base value.
- 2.132 Multiplying factors for different types of accommodation corresponding to a low probability of adverse comment are as follows:

Operating theatre, precision laboratory, audiometric testing booth	1
Wards	2
General laboratories, treatment areas	4
Offices, consulting rooms	8

Intermittent vibration

- 2.133 Intermittent vibration may conservatively be assumed to be continuous. Alternatively, if the duration and frequency of occurrence of events are known, the vibration dose value (VDV) may also

be used. VDV is defined in BS 6472, and values corresponding to a low probability of adverse comment for different types of accommodation are given below.

Wards	$0.2 \text{ m s}^{-1.75}$
General laboratories, treatment areas	$0.4 \text{ m s}^{-1.75}$
Offices, consulting rooms	$0.8 \text{ m s}^{-1.75}$

- 2.134 In the case of operating theatres and precision laboratories, it is not appropriate to make allowance for intermittent events, and the maximum frequency-weighted acceleration should be within the limits set for continuous vibration.

Vibration-sensitive equipment

- 2.135 Some specialist medical equipment (for example scanners and some microscopes) is particularly sensitive to vibration. Meeting the vibration criteria above does not guarantee that such equipment will not be affected by vibration.
- 2.136 A specialist should assess the suitability of a proposed site for such equipment. This will require reference to vibration performance requirements supplied by the manufacturer of the equipment. The specialist should consider all likely sources of vibration, which might include footfalls, plant, nearby vehicular traffic or railways, loading, unloading and other facilities-management activities.
- 2.137 It should also be noted that laboratory furniture can often amplify ambient vibration, depending on design, and special bench designs may be required for sensitive microscopes, balances etc.



Audiology testing room (photograph courtesy of Industrial Acoustics Company)

3 Construction noise and vibration

- 3.1 A strategy should be drawn up to control construction noise and vibration where this is likely to affect an existing healthcare facility or residential areas (see BS 5228).
- 3.2 Each project will have different and specific requirements, so only outline information can be given here.
- 3.3 The strategy should include:
- policy for operating hours;
 - policy for planning noisy activities and agreeing systems for liaison between contractors and healthcare staff;
 - policy for emergency situations where work has to proceed outside the agreed time slots;
 - acoustic treatment to fixed plant;
 - location of temporary access roads and access to the site;
 - equipment for cutting and breaking concrete;
 - control of vibration transfer from construction areas to occupied areas;
 - use of temporary screening;
 - unacceptable construction equipment (for example driven piles, untreated temporary generators etc);
 - noise-monitoring policy.

4 Temporary healthcare facilities

- 4.1 Temporary facilities provided during the construction process ideally need to meet the standards set out above as far as practicable. There may be practical limitations to the acoustic performance achievable within some types of temporary accommodation.
- 4.2 It is important to understand the implications of this and agree specific acoustic requirements. Areas where it is not possible to achieve the standards within this document should be identified, and a decision made on the type of temporary building required.

5 Refurbished accommodation

- 5.1 Refurbished buildings ideally need to meet the criteria set out in this document. There may be practical limitations to the acoustic performance achievable within existing buildings.
- 5.2 It is important to investigate what elements of the existing building are part of the refurbishment and agree specific acoustic requirements. Areas where it is not possible to achieve the criteria within this document should be identified, and a decision made on the extent of the refurbishment.

Example 1

Flanking sound in retained structures may limit the sound insulation achievable between rooms. Unless existing structures, services etc are also to be upgraded, there can be limited benefit in providing high performance partitions.

Example 2

If an existing ventilation system is to be retained without any changes, the noise criteria in [Table 2](#) may not be achievable.

Example 3

If the existing windows are to be retained, the intrusive noise criteria given in [Table 1](#) may not be achievable.

6 Inspecting works during construction

- 6.1 To ensure that the construction is acoustically robust, an acoustic specialist should monitor the installation by regular visits to site. The specialist should ensure that workmanship is of sufficient standard to meet the target acoustic performances, and help train site personnel to spot and deal with acoustic issues. This provides opportunities to improve construction methods before acoustic testing.



Site inspection (photograph courtesy of Sound Research Laboratories Ltd)

7 Testing and validation

- 7.1 A testing programme should be agreed before construction. This should include the following.

Sound insulation

- 7.2 Test procedures should be in accordance with BS EN ISO 140-4 and BS EN ISO 140-7.
- 7.3 Tests should be carried out by a body accredited by the United Kingdom Accreditation Service (UKAS) or the Association of Noise Consultants (ANC) for doing such tests.
- 7.4 Performance should be rated in accordance with BS EN ISO 717-1 and BS EN ISO 717-2.
- Airborne sound insulation testing of a random selection of partition and floor types: to include typical wards, consulting rooms and maternity facilities as a minimum. These tests should be done at the earliest opportunity (preferably in a complete mock-up on site) to identify potential weaknesses before these are replicated in numerous areas.
 - Impact sound insulation testing of a random selection of floor types: to include typical floors over wards as a minimum, plus other sensitive areas identified during the design as needing additional impact sound insulation.
 - A typical test regime would be airborne tests on eight partitions of each construction type plus airborne and impact tests on four floors of each construction type: to include a selection of flanking arrangements (for example internal walls, external cladding, masonry walls).

Noise levels generated by mechanical and electrical services

- 7.5 Services should be operating at their maximum normal design duty before the following checks take place:
- noise levels should be measured in randomly selected areas, particularly those close to plantrooms. This should include measurements

of noise levels during start-up where this is a noisy operation;

- testing should include measurements in at least five clinical rooms served by each ventilation system;
- the rooms selected should have the lowest NR criterion for that system and/or be closest to the branch off the main duct. In addition, measurements should be made in representative clinical rooms adjacent to plantrooms and external plant areas;
- tests should be undertaken before medical equipment is installed or operational, unless there has been agreement that this equipment should also meet the criterion;
- tests should be carried out when the rooms are furnished but unoccupied. If it is not possible to test when rooms are furnished, an allowance may be made for the expected difference in reverberation time when the room becomes furnished;
- reductions in the number of tests may be acceptable if, for example, there is repetition of design;
- the measurements in each room should be spatially averaged, with each measurement position representing the use of the room (minimum of three measurements per room);
- the measurement time period selected should represent the use of the room and/or the operation of the plant/equipment;
- other test requirements should be taken from the ANC's guidelines – 'Noise measurement in buildings'.

Intrusive noise

- 7.6 The following measurements should be taken from a sample of rooms during daytime and night-time:

- a typical requirement would be for spatially averaged measurements in representative rooms on each façade (and at a number of floor levels if the external noise level varies with height on the façade);
- during measurements, windows and trickle ventilators should be open as required to achieve the required amount of ventilation;
- measurements should be made for a period of time that represents the use of the room and the external noise sources;
- the measurements in each room should be spatially averaged, with each measurement position representing the use of the room (a minimum of three measurements per room);
- if the external noise sources are sufficiently constant, measurement time periods of less than one hour are acceptable;
- tests should be done when the rooms are furnished but unoccupied;
- if it is not possible to test when rooms are furnished, an allowance may be made for the expected difference in reverberation time when the room becomes furnished;
- other test requirements should be taken from the ANC's guidelines – 'Noise measurement in buildings';
- due to the practical problems for measuring rain noise on a completed building, it will normally be acceptable to prove the performance by calculations based on the laboratory-measured rain-noise data for the roof system used.

Audio system intelligibility

7.7 An STI to BS EN 60268-16 (or equivalent parameter and standard as identified in **paragraphs 2.115–2.119**) should be measured for each audio system. The following should be taken into account:

- reductions in the number of tests may be acceptable if, for example, there is repetition of design;
- measurements should be made at locations that represent the room use;
- tests should be done when the rooms are furnished but unoccupied;

- if it is not possible to test when rooms are furnished, an allowance may be made for the expected difference in reverberation time when the room becomes furnished;
- other test requirements should be taken from the ANC's guidelines – 'Noise measurement in buildings'.

Environmental noise

7.8 All plant should be operating at its maximum normal design duty. The following should also be taken into account:

- suitable measurements should be made to check compliance with planning conditions etc as appropriate;
- appropriate locations and times should be selected, noting that measurements will probably be needed at night;
- where agreement has been made for relaxing noise criteria for emergency plant, it should be tested separately.

Audiometric testing rooms

7.9 Airborne sound insulation, impact sound isolation, intrusive noise and service-noise measurements should be carried out in all audiology rooms/booths:

- testing should be done when the facility is operational, otherwise worst-case expected operational noise levels should be re-created;
- specialist sound-level-measuring equipment will be needed to measure low noise levels in testing rooms;
- due to the practical limitations of measuring accurate reverberation times in small rooms (particularly at low frequencies), normally the performance should be proved by calculations based on the laboratory-measured absorption data for the materials/furnishings used.

General comments

7.10 Noise and vibration measurements should be made using suitable instrumentation in accordance with BS EN 61672 Parts 1 and 2, following the British and International standards as identified above or other appropriate standards where relevant. The equipment used should have calibration certification traceable to national standards.

- 7.11 Personnel chosen to carry out the commissioning tests should be suitably trained in the test procedures and relevant Standards.

Failure to meet criteria

- 7.12 In the event of a failure to meet the project's acoustic criteria:
- elements that do not meet the agreed performances set out in the acoustic strategy document should be remedied;
 - test failures that indicate poor workmanship or design should normally result in testing of other areas, to show whether they meet the standards;
 - the responsibility for failures may be due to more than one party, depending on individual circumstances;
 - an acoustic specialist representing interested parties may decide to allow small individual failures, and this will depend on individual circumstances. Generally, 1 dB or 2 dB is considered negligible in acoustic terms, as this difference is undetectable to normal human hearing. However, this does not justify planned under-design of the building.



Acoustic testing on site (photograph courtesy of Sound Research Laboratories Ltd)

Commissioning results

- 7.13 The following measurement results should be presented:
- airborne-sound-insulation ratings (in terms of $D_{nT,w}$);
 - impact sound insulation (in terms of $L'_{nT,w}$);
 - noise levels generated by mechanical services (in terms of NR);
 - intrusive noise levels (in terms of $L_{Aeq, 1hr}$ and $L_{Amax, f}$ as appropriate);
 - speech intelligibility ratings (in terms of STI or equivalent);
 - environmental noise levels (in terms of the appropriate parameter);
 - audiometric testing rooms – all results as required in [paragraph 7.9](#);
 - comparison of all commissioning results with design criteria, statement of acceptability, details of remedial measures and subsequent changes in results.

8 Checklists

- 8.1 The following are suggested as an initial check of the most important acoustic issues, but are not intended to be an exhaustive list.

Planning	Check
Imaging equipment is located on a ground-bearing slab where possible (airborne noise and vibration can be generated)	
Vibration-sensitive equipment is located away from sources of vibration and structures with appropriate vibration characteristics	
The helipad is located as far away from local residences and ward areas as possible (within operational constraints)	
Energy centre, generators, service yards, delivery areas are located away from sensitive areas within and outside the site boundary	
Noisy roof plant is not over sleeping areas, and noise to atmosphere outside the site is appropriately controlled	
Waiting areas are not next to doors into “private”, “confidential” or “sensitive” areas	
“Sensitive” or “medium sensitivity” areas with openable windows are located away from noisy areas or areas where external seating is provided	
Heavily trafficked corridors are not above sensitive spaces	
Interconnecting doors between private areas are avoided	
Laundries, sterile services departments etc are located away from sensitive areas	
Noise-sensitive accommodation is under a roof that will adequately control rain noise	
Internal acoustics	Check
There is adequate sound-absorption provision in all occupied spaces	
Ceiling tiles are sufficiently absorbent and cleanable	
Sound-absorbent materials used in acoustic treatments have encapsulated acoustic materials where necessary	
Sound absorption is provided in patient areas where this does not conflict with cleaning and maintenance strategies	
Atria are provided with acoustic treatment	
Absorption is provided around nurse stations to minimise noise transfer	
Internal sound insulation and privacy	Check
“Confidential” or “private” rooms with openable windows are located and designed to minimise sound directly reflecting into other open windows	
External areas near openable windows in “private”, “confidential” or “sensitive” rooms are not easily accessible from outdoors	
Crosstalk via ducting has been controlled	
Noise transmission via flanking elements has been controlled (for example, internal linings on external walls are not continuous between rooms; partition junctions have been designed to minimise flanking)	
Full-height partitions (that is, to the soffit) have been provided where required	
Sources of structure-borne sound are adequately controlled	
Sound-masking has been considered for high-privacy areas, with adjustable volume in multi-bed wards	
Potential conflicts for door requirements have been considered and resolved	
Waiting areas are not immediately outside “confidential” or “private” rooms	
Acoustic doors are operable by disabled users	
Impact noise has been controlled where necessary	

Services noise	Check
There is adequate attenuation of ventilation system noise to internal areas	
There is adequate attenuation to meet external noise limits with all plant operating	
There is adequate attenuation to deal with start-up noise	
Balancing can be accomplished without excessive noise	
Duct velocities are appropriate to meet the target criteria	
Resilient fixings are used for plumbing fittings on lightweight walls around sleeping areas	
Attenuators and other in-duct acoustic treatments for clinical areas have fully bagged acoustic material if required	
Lifts are located away from sensitive areas	
Transformers are located away from sensitive areas and sufficient controls on structure-borne noise are incorporated	
Blow-down attenuators, boiler-flue attenuators and burner shrouds have been provided to control noise from boilers	
Plantroom noise levels are below thresholds for hearing protection and, where this is not reasonably practicable, adequate warnings have been provided	
Noise from rainwater and waste pipes is controlled so that sensitive areas are not adversely affected	
Structural vibration	Check
The structure has been designed to meet the required vibration levels from footfalls and other vibration sources	
Vibration in a non-sensitive space (for example corridors) does not cause excessive vibration in a nearby sensitive area	
Equipment is properly isolated from the structure	
Laboratory furniture has been assessed for vibration amplifications	
Provisions have been made for very sensitive medical equipment	
Fit-out equipment	Check
Equipment noise does not adversely affect the use of the room	
Metal bins incorporate quiet closing methods and damping	
Internal cooling fans for electronic equipment are of the low-noise type	
Water coolers are of the low-noise type	
Provision has been made for the control of noise from bedpan washers, macerators, sluices etc	
Door-closers minimise noise generation	
Management issues	Check
Noise from nurse stations during changeovers has been considered	
Quiet nurse-call systems have been considered	

9 Partition and floor sound insulation

9.1 The target sound insulation between rooms is specified in terms of the in-situ room-to-room weighted standardised level difference $D_{nT,w}$. Partition constructions required, however, should be determined based on laboratory-tested weighted sound-reduction index values R_w . The difference between the two values depends on a number of factors, including:

- the surface area of the separating wall/floor (m^2);
- the volume of the receiving room (m^3);
- the standard of workmanship;
- the acoustic integrity of flanking constructions, junction details and service penetrations.

9.2 As described in the text, values of 7 dB (lightweight construction) and 4 dB (masonry construction) are typical to allow for a reasonable standard of workmanship and a small amount of flanking (that is, a lightweight partition on site is likely to be at least 7 dB below its laboratory-tested performance).

a. To calculate the R_w required to meet a given $D_{nT,w}$, the following relationships should be used:

(i) For lightweight walls/floors:

$$R_w \equiv D_{nT,w} - 10 \log (T/T_r) + 10 \log (ST/0.16V) + 7.$$

(ii) For masonry walls/floors:

$$R_w \equiv D_{nT,w} - 10 \log (T/T_r) + 10 \log (ST/0.16V) + 4.$$

Where:

S = common area of separating element being considered (m^2);

V = volume of receiving room (m^3);

T = measured reverberation time in receiver room as per BS EN ISO 140-4;

T_r = the reference reverberation time, to be taken as 0.8 seconds.

This simplifies to:

(i) For lightweight walls/floors:

$$R_w \equiv D_{nT,w} + 10 \log (S/V) + 14.$$

(ii) For masonry walls/floors:

$$R_w \equiv D_{nT,w} + 10 \log (S/V) + 11.$$

b. For cuboid-shaped receiving rooms, where the separating element is the whole of one surface, this can be further simplified to:

(i) For lightweight walls/floors:

$$R_w \equiv D_{nT,w} - 10 \log d + 14.$$

(ii) For masonry walls/floors:

$$R_w \equiv D_{nT,w} - 10 \log d + 11.$$

Where:

d = dimension of receiving room perpendicular to separating element being considered (height of room for floor, width or depth of room for partitions, depending on which is perpendicular to the partition being considered).

Note

\equiv means “is equivalent to”.

9.3 For very small receiving rooms that do not produce noise and are not sensitive to noise (such as a linen store), the sound insulation derived from the above equations is unnecessarily high, owing to the small dimensions. Provided the receiving room is not normally occupied (and when it is, only by staff), the receiving room may be assumed to have the same dimensions as the source room. If someone were to spend time in the linen store (in this example), the level of privacy from the adjacent room would be low. See examples in paragraphs 9.4–9.14 and Figures 10–16 for more details.

Figure 10 Calculation of R_w from $D_{nT,w}$ for lightweight constructions


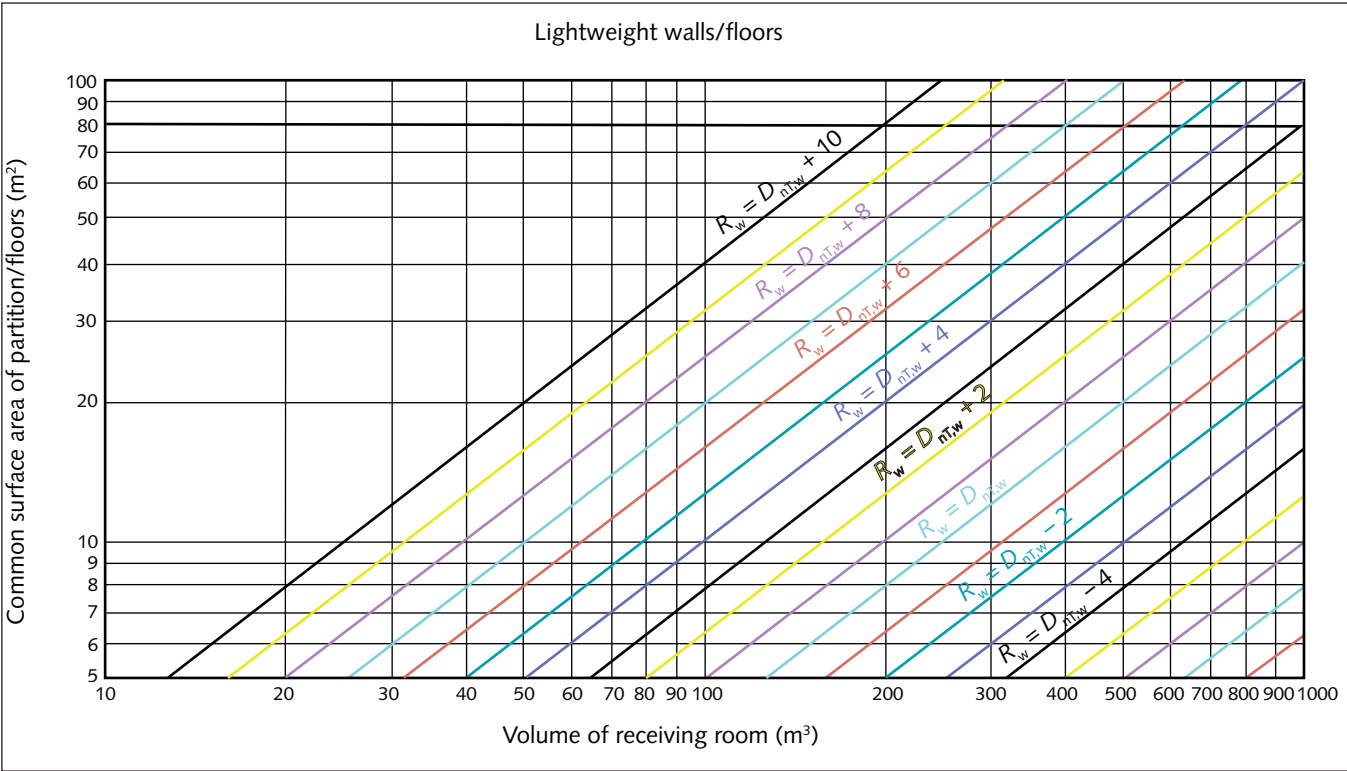


Figure 11 Calculation of R_w from $D_{nT,w}$ for masonry constructions

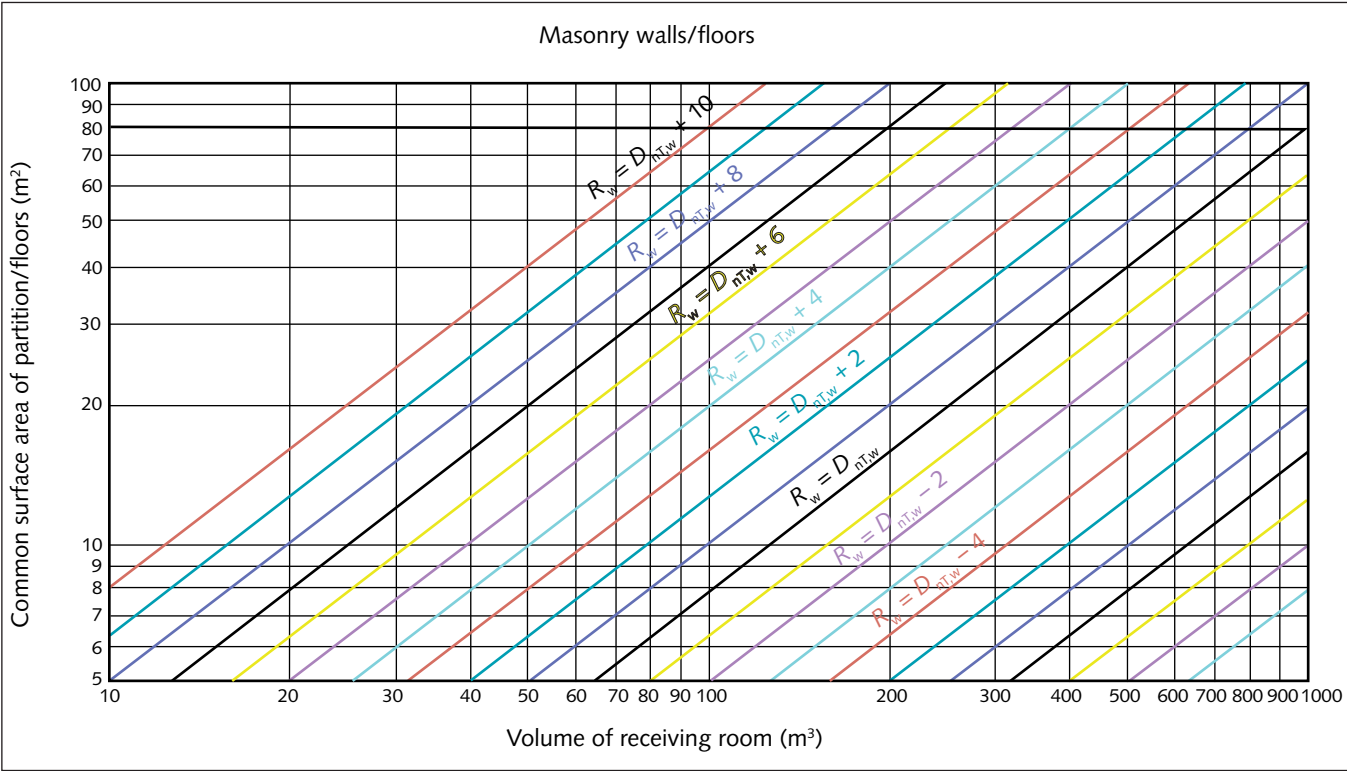

Example 1. Lightweight partition – absorbent ceilings

- 9.4 Consulting room 1 is next to consulting room 2. The lightweight partition between the rooms is 11 m^2 ; this area is common to both consulting rooms. Each consulting room has a volume of 34 m^3 , and both rooms have a Class C ceiling covering at least 80% of the floor area.

Consulting room 1 to consulting room 2 (from Tables 3 and 4):

- Source: Confidential, typical
- Receiver: Medium
- $D_{nT,w}$ required: 47 dB.

Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$\begin{aligned} R_w &= D_{nT,w} + 9 \text{ dB} \\ &= 56 \text{ dB.} \end{aligned}$$


From consulting room 2 to consulting room 1:

Calculation is the same as above, so:

$$R_w = 56 \text{ dB.}$$

- 9.5 A partition rated at $R_w = 56 \text{ dB}$ (or above) should be selected from manufacturers' certified test data.

Figure 12 Example 1

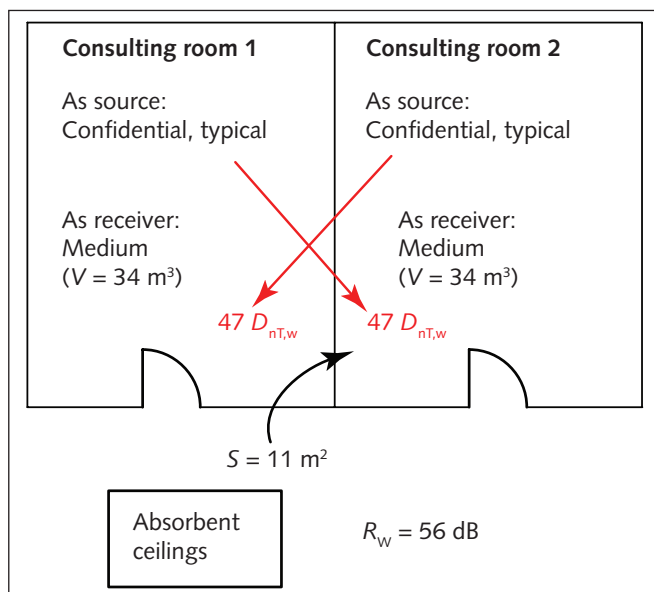

Example 2. Concrete floor – absorbent ceilings

- 9.6 Bedroom A is above part of bedroom B. The common area of concrete floor between the rooms is 20 m^2 . Bedroom A has a volume of 72 m^3 and bedroom B has a volume of 60 m^3 . Both rooms have a Class C ceiling covering at least 80% of the floor area.

Bedroom A to bedroom B (from Tables 3 and 4):

- Source: Confidential, typical
- Receiver: Medium
- $D_{nT,w}$ required: 47 dB.

Using Figure 11 or equations in paragraph 9.2 (for masonry constructions):

$$\begin{aligned} S &= 20 \text{ m}^2 \text{ and } V = 60 \text{ m}^3 \\ R_w &= D_{nT,w} + 6 \text{ dB} \\ &= 53 \text{ dB.} \end{aligned}$$

From bedroom B to bedroom A:


- Source: Confidential, typical
- Receiver: Medium
- $D_{nT,w}$ required: 47 dB

Using Figure 11 or equations in paragraph 9.2 (for masonry constructions):

$$\begin{aligned} S &= 20 \text{ m}^2 \text{ and } V = 72 \text{ m}^3 \\ R_w &= D_{nT,w} + 5 \text{ dB} \\ &= 52 \text{ dB.} \end{aligned}$$

- 9.7 A floor/ceiling construction rated at $R_w = 53 \text{ dB}$ (or above) should be selected.

Figure 13 Example 2

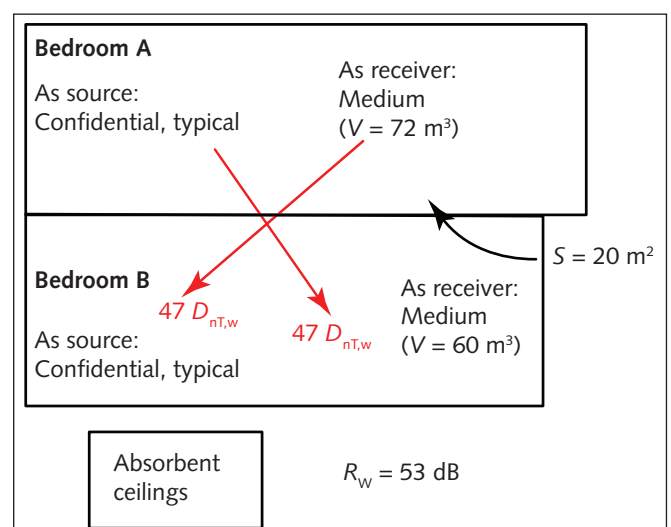

Example 3. Lightweight partition – non-absorbent ceilings

9.8 Operating theatre 1 is next to operating theatre 2. Due to hygiene and washability requirements, it is agreed that the theatres cannot accommodate acoustic absorption material. The lightweight partition between the rooms is 15 m^2 and this area is common to both theatres. Each theatre has a volume of 60 m^3 .

Theatre 1 to theatre 2 (from Tables 3 and 4):

- Source: Private, typical
- Receiver: Sensitive
- $D_{nT,w}$ required: $47 \text{ dB} + 3 \text{ dB}$ (due to lack of absorption material)
= 50 dB .

Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$R_w = D_{nT,w} + 8 \text{ dB} \\ = 58 \text{ dB}.$$

Theatre 2 to theatre 1 (from Tables 3 and 4):


- Source: Private, typical
- Receiver: Sensitive
- $D_{nT,w}$ required: $47 \text{ dB} + 3 \text{ dB}$ (due to lack of absorption material)
= 50 dB .

Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$R_w = D_{nT,w} + 8 \text{ dB} \\ = 58 \text{ dB}.$$

9.9 A partition rated at $R_w = 58 \text{ dB}$ (or above) should be selected from manufacturers' certified test data.

Figure 14 Example 3

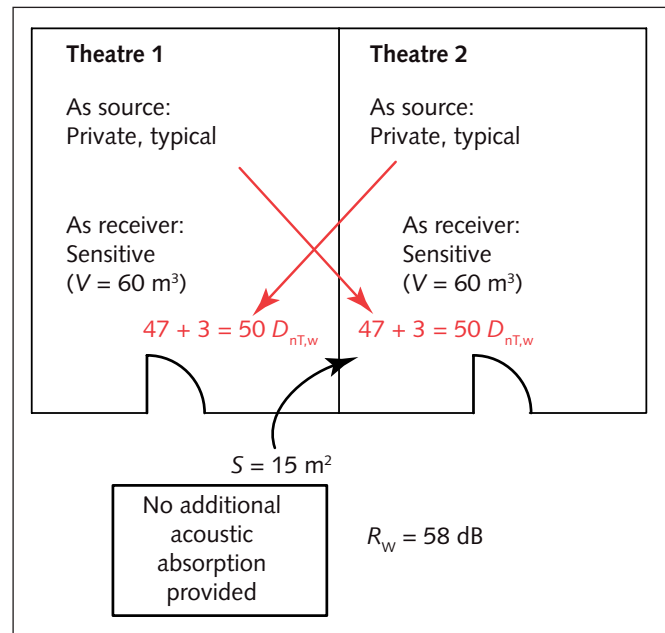

Example 4. Lightweight partition – absorbent ceilings – different room uses

9.10 A dirty utility is next to a consulting room. The dirty utility has a volume of 18 m^3 ; the consulting room volume is 60 m^3 , and the common lightweight partition between them is 6 m^2 . Both rooms have a Class C ceiling covering at least 80% of the floor area.

Consulting room to dirty utility (from Tables 3 and 4):

- Source: Confidential, typical
- Receiver: Not sensitive
- $D_{nT,w}$ required: 47 dB.

Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$S = 6 \text{ m}^2 \text{ and } V = 18 \text{ m}^3$$

$$\begin{aligned} R_w &= D_{nT,w} + 9 \text{ dB} \\ &= 56 \text{ dB.} \end{aligned}$$

Dirty utility to consulting room (from Tables 3 and 4):

- Source: Not private, high
- Receiver: Medium
- $D_{nT,w}$ required: 42 dB.


Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$S = 6 \text{ m}^2 \text{ and } V = 60 \text{ m}^3$$

$$\begin{aligned} R_w &= D_{nT,w} + 4 \text{ dB} \\ &= 46 \text{ dB.} \end{aligned}$$

9.11 A partition rated at $R_w = 56 \text{ dB}$ (or above) should be selected from manufacturers' certified test data.

Figure 15 Example 4

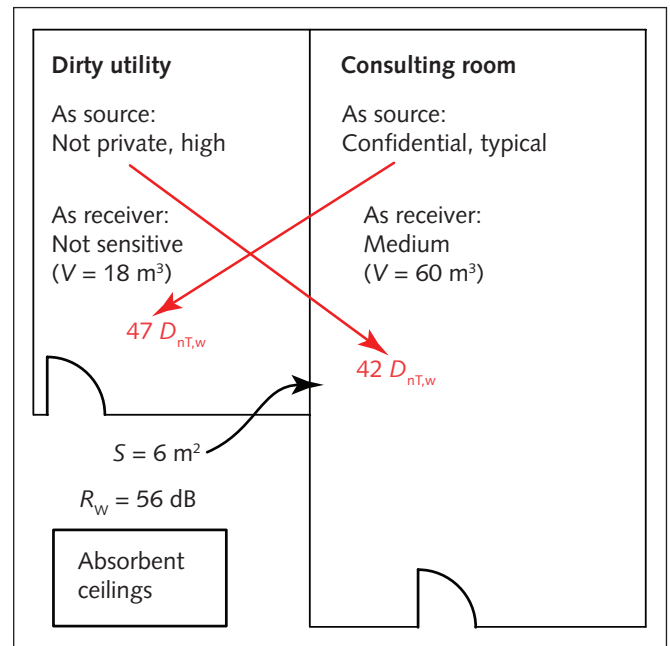

Example 5. Lightweight partition – absorbent ceilings – small non-sensitive room

9.12 A bedroom is next to a linen store. The linen store has a volume of 10 m^3 ; the bedroom's volume is 50 m^3 and the common lightweight partition between them is 3.5 m^2 . Both rooms have a Class C ceiling covering at least 80% of the floor area.

Bedroom to linen store (from Tables 3 and 4):

- Source: Confidential, typical
- Receiver: Not sensitive
- $D_{nT,w}$ required: 47 dB.

Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$S = 3.5 \text{ m}^2 \text{ and } V = 10 \text{ m}^3$$

$$\begin{aligned} R_w &= D_{nT,w} + 9 \text{ dB} \\ &= 56 \text{ dB.} \end{aligned}$$

Linen store to bedroom (from Tables 3 and 4):

- Source: Not private, low
- Receiver: Medium
- $D_{nT,w}$ required: No rating

9.13 Following the normal rules set out, a partition rated at $R_w = 56 \text{ dB}$ (or above) should be selected from manufacturers' certified test data. However, the text in paragraph A3 describes what to do in this situation. Assuming that the linen store is not normally occupied, and when it is, by staff only, the dimensions of the receiving room can be taken to be the same as those of the source room:

Bedroom to linen store (from Tables 3 and 4):

- Source: Confidential, typical
- Receiver: Not sensitive
- $D_{nT,w}$ required: 47 dB.


Using Figure 10 or equations in paragraph 9.2 (for lightweight constructions):

$$S = 3.5 \text{ m}^2 \text{ and } V = 50 \text{ m}^3$$

$$\begin{aligned} R_w &= D_{nT,w} + 2 \text{ dB} \\ &= 49 \text{ dB.} \end{aligned}$$

9.14 This gives a more realistic requirement for R_w of 49 dB.

Figure 17 Example 5

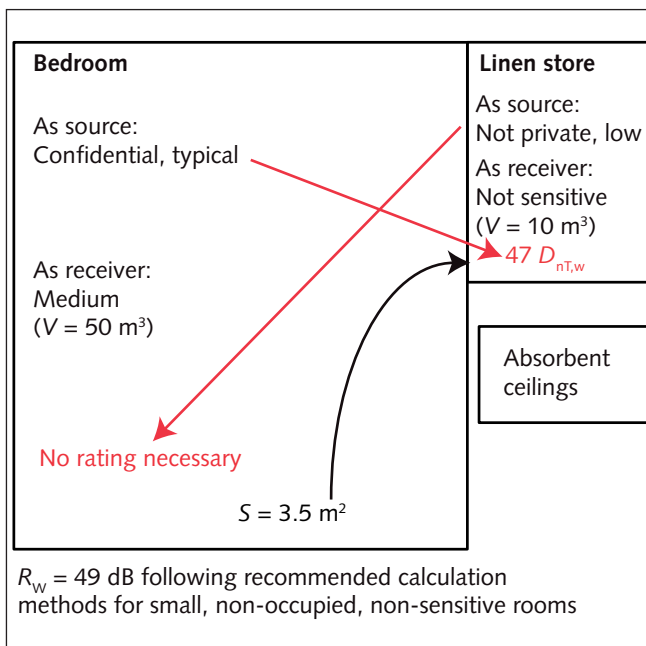

10 Calculation of equivalent absorption area

- 10.1 Paragraphs 2.105–2.114 describe how acoustic absorption should be incorporated in occupied spaces to enhance the acoustic environment.

Method A

- 10.2 Acoustically-absorbent materials should have a minimum absorption area equivalent to a Class C absorber covering an area of at least 80% of the room's floor area. It will normally be convenient to cover the ceiling with this absorption, provided suitable ceiling tiles are selected that meet hygiene and washability requirements.

Method B

- 10.3 If materials with a better absorption class (Class A or Class B) are used, the required minimum surface

area of the absorption material is reduced. The required surface area of material should be calculated as follows:

Room floor area = $A \text{ m}^2$.

Minimum 80% to be covered with class C absorber = $0.8A$.

Absorption area required = Class C absorption coefficient $\times 0.8A$ at octave band frequency.

Required surface area of absorbent material =

$$\frac{\text{Absorption area required}}{\text{Absorption coefficient of selected material}}$$

- 10.4 The following example illustrates the above procedure.

The concrete soffit of an office is being left exposed, and an absorbent ceiling cannot be fitted. The floor area of the office is 25 m². What surface area of an alternative absorbent material should be used?

Step 1. Calculate the minimum absorption area required						Line
Floor area of 25 m ² \times 0.8 = 20 m ²						1
Octave band frequency (Hz)	250	500	1000	2000	4000	2
Absorption coefficient of typical healthcare Class C ceiling	0.35	0.55	0.7	0.8	0.9	3
20 m ² \times Class C coefficient = absorption area required (m ²)	7	11	14	16	18	4
Step 2. Calculate the absorption area provided by selected materials						
Thin carpet (25 m ²) absorption coefficient	0.03	0.06	0.15	0.30	0.40	5
Thin carpet absorption area (25 m ² \times line 5)	0.75	1.5	3.75	7.5	10	6
Step 3. Determine whether there is sufficient absorption area						
Extra absorption area required (m ²): (line 4 – line 6)	6.25	9.5	10.25	8.5	8	7
Step 4. Try adding extra absorption with wall panels to make up shortfall						
Wall-panel absorption coefficient	0.65	1.0	1.0	1.0	0.95	8
Required surface area of wall panel = Extra absorption area required/ Wall panel absorption coefficient [that is, (line 7 \div line 8)]	9.6	9.5	10.25	8.5	8.4	9
Therefore, in this example, 10.25 m² of wall panel with the stated absorption coefficient is required						

11 Worked examples of vibration performance criteria

11.1 A waste compactor runs four times a day for three minutes. The compactor will produce vibration that affects a nearby room. The structural engineer² calculates that the vibration will be sinusoidal with a frequency of 16 Hz and an RMS acceleration of 0.05 m s^{-2} . There will be no other significant vibration in the room. What can the room be used for?

- Step 1 – calculate the frequency-weighted acceleration level:

$$\begin{aligned} & \text{RMS acceleration} \times \text{frequency weighting of } W_g \\ & \text{(BS 6841) at 16 Hz} \\ & = 0.05 \text{ m s}^{-2} \times 0.500 \\ & = 0.025 \text{ m s}^{-2}. \end{aligned}$$

- Step 2 – calculate the multiplying factor:

$$\begin{aligned} & \frac{\text{Frequency weighted acceleration level}}{\text{Base value (} 0.005 \text{ m s}^{-2} \text{)}} \\ & = \frac{0.025 \text{ m s}^{-2}}{0.005 \text{ m s}^{-2}} = 5 \end{aligned}$$

Although the vibration is intermittent, it should be considered continuous when assessing whether it is acceptable for an operating theatre or precision laboratory. As the multiplying factor is greater than 1, this room would not be suitable for an operating theatre or precision laboratory.

To assess the suitability of the intermittent vibration for other room types, the vibration dose value (VDV) should be used. The VDV can be calculated using the methods in BS 6472.

In this example, the VDV can be calculated using the full integration method in BS 6472 and is found to be $0.14 \text{ m s}^{-1.75}$. As this is less than $0.2 \text{ m s}^{-1.75}$, the room may be used as a ward.

Using the simpler method in BS 6472 to estimate the VDV (eVDV), the result is:

$\text{eVDV} = 1.4 \times \text{frequency-weighted acceleration level} \times t^{0.25}$ (where t is the total duration of vibration exposure in seconds).

Therefore:

$$\begin{aligned} \text{VDV} &= 1.4 \times 0.025 \text{ m s}^{-2} \times (3 \text{ minutes} \times 4 \text{ times per day} \times 60)^{0.25} \\ &= 0.18 \text{ m s}^{-1.75}. \end{aligned}$$

In this case, the two methods give the same outcome, even though the results are different.

11.2 A proposed layout has a corridor located at mid-span. The structural engineer² calculates that for people walking at a brisk pace (2.4 steps per second), the floor slab in an adjacent room vibrates with an RMS acceleration of 0.015 m s^{-2} at a frequency of 7.2 Hz. People walking at a less hurried pace (1.8 steps per second) within the room itself generate vibration in the floor slab with an RMS acceleration of 0.009 m s^{-2} , also at a frequency of 7.2 Hz. What can the room be used for?

- Step 1 – calculate the frequency-weighted acceleration level:

$$\begin{aligned} & \text{RMS acceleration} \times \text{frequency weighting of } W_g \\ & \text{(BS 6841) at 7.2 Hz} \\ & = 0.015 \text{ m s}^{-2} \times 1.000 \\ & = 0.015 \text{ m s}^{-2} \end{aligned}$$

- Step 2 – calculate the multiplying factor:

$$\begin{aligned} & \frac{\text{Frequency weighted acceleration level}}{\text{Base value (} 0.005 \text{ m s}^{-2} \text{)}} \\ & = 0.015 \text{ m s}^{-2} / 0.005 \\ & = 3 \end{aligned}$$

Assuming the vibration is continuous, compare the calculated multiplying factor to the values in paragraphs 2.128–2.132. This room is not suitable for an operating theatre or a ward. It is suitable for use as a general laboratory, treatment area or consulting room.

² Structural engineers might use various methods to calculate the acceleration levels in a particular building. The most appropriate method should be determined in each case.

12 Glossary

Absorption area: the surface area of material (in m^2) multiplied by its absorption coefficient.

Absorption coefficient: a measure of the proportion of sound not reflected when striking a surface.

Airborne sound insulation: the reduction of sound that is in the air on passing through a building element.

ANC: Association of Noise Consultants.

Attenuator: device that reduces noise, particularly plant noise and crosstalk – often colloquially (and incorrectly) known as a silencer.

Audiometric facilities: rooms used for hearing tests and associated activities.

Bathroom pod: a pre-fabricated bathroom.

Background noise level (L_{A90}): the A-weighted noise level exceeded for 90% of the measurement period. Commonly regarded as the background noise level.

Background noise level (L_{90}): the linear (not A-weighted) noise level exceeded for 90% of the measurement period. Used as the parameter for measuring service-noise NR levels.

Competent Person: someone with appropriate training, qualifications, experience and skill. The person will normally have a diploma or degree in acoustics or a related subject.

Crosstalk: noise transfer between rooms, often via ventilation ductwork.

dB(A): a single-figure rating to a sound, which represents the human-ear frequency response.

Decibel (dB): the unit used for many acoustic qualities to indicate the level with respect to a reference level. For sound pressure, the reference value is normally $20 \mu\text{Pa}$.

Equivalent continuous sound pressure level (L_{Aeq}): commonly regarded as the A-weighted “average” noise level over a period of time.

Equivalent continuous sound pressure level (L_{eq}): the linear (not A-weighted) equivalent continuous sound-pressure level.

Frequency (Hz): the number of sound waves to pass a point in one second.

Frequency-weighted acceleration: the acceleration multiplied by a specified weighting value.

Impact sound insulation: the reduction of sound created by impacts (for example footfalls) on floor slabs over a room.

IPS panels: integrated plumbing systems – pre-plumbed and pre-fabricated panels often used for toilets, hand-wash basins, showers etc.

L_{Amax} , L_p : the highest A-weighted sound-pressure level measured during a given period.

Mechanical-service noise: noise generated by mechanical and electrical services.

Noise intrusion: noise from external noise sources.

Noise rating (NR) curves: a set of curves based on the sensitivity of the human ear. Used to give a single figure for noise levels at a range of frequencies. In this document, NR is intended to be defined between 63 Hz and 4 kHz.

Octave bands: a convenient division of the frequency scale, identified by their centre frequency. Typically 63, 125, 250, 500, 1000, 2000, 4000, 8000 Hz.

Reverberation time: the time that is taken for sound in a space to decrease by 60 dB. A high reverberation time means the room is echoic. A low reverberation time means the room is acoustically dead.

RMS: root mean square.

Snoezelen room: a room used to stimulate the various senses as desired.

Speech intelligibility: how easily speech can be understood.

Speech transmission index (STI): a measure of how intelligible speech is.

UKAS: the United Kingdom Accreditation Service.

Vibration dose value (VDV): a value that reflects the exposure to vibration over time.

Warble tones: sounds used in audiometric testing, normally played over loudspeakers in paediatric test rooms.

Weighted sound level difference (D_w): unit for rating airborne sound insulation on site (see BS EN ISO 140-4).

Weighted sound reduction index (R_w): unit for rating airborne sound insulation in a laboratory (see BS EN ISO 140-3).

Weighted standardised level difference ($D_{nT,w}$): unit for rating airborne sound insulation on site (see BS EN ISO 140-4).

Weighted standardised impact sound pressure level ($L'_{nT,w}$): unit for rating impact airborne sound insulation on site (see BS EN ISO 140-7).

13 References

Acts and regulations

Building Regulations 2000. SI 2000 No 2531. HMSO, 2000.

Building Regulations 2000: Approved Document E: Resistance to the passage of sound. Department for Communities and Local Government, 2003 (as amended).

Building Regulations 2000: Approved Document F: Ventilation. Department for Communities and Local Government, 2006.

Control of Noise at Work Regulations 2005. SI 2005 No. 1643. HMSO, 2005.

British, European and International Standards

BS 5228-1:1997. Noise and vibration control on construction and open sites. Code of practice for basic information and procedures for noise and vibration control. British Standards Institution, 1997.

BS 5228-2:1997. Noise and vibration control on construction and open sites. Guide to noise and vibration control legislation for construction and demolition including road construction and maintenance. British Standards Institution, 1997.

BS 5228-3:1997. Noise and vibration control on construction and open sites. Code of practice applicable to surface coal extraction by opencast methods. British Standards Institution, 1997.

BS 5228-4:1992. Noise and vibration control on construction and open sites. Code of practice for noise and vibration control applicable to piling operations. British Standards Institution, 1992.

BS 5228-5:1997. Noise and vibration control on construction and open sites. Code of practice applicable to surface mineral extraction (except coal) sites. British Standards Institution, 1997.

BS 6841:1987. Guide to measurement and evaluation of human exposure to vibration in buildings (1 Hz to 80 Hz). British Standards Institution, 1987.

BS 6841:1987. Guide to measurement and evaluation of human exposure to whole-body mechanical vibration and repeated shock. British Standards Institution, 1987.

BS EN 60268-16:2003. Sound system equipment. Objective rating of speech intelligibility by speech transmission index. British Standards Institution, 2003.

BS EN 60804:2001, IEC 60804:2001. Integrating-averaging sound level meters. British Standards Institution, 2001.

BS EN 61672-1:2003. Electroacoustics. Sound level meters. Specifications. British Standards Institution, 2003.

BS EN 61672-2:2003. Electroacoustics. Pattern evaluation tests. British Standards Institution, 2003.

BS EN ISO 140-3:1995, BS 2750-3:1995. Acoustics. Measurement of sound insulation in buildings and of building elements. Laboratory measurement of airborne sound insulation of building elements. British Standards Institution, 1995.

BS EN ISO 140-4:1998. Acoustics. Measurement of sound insulation in buildings and of building elements. Field measurements of airborne sound insulation between rooms. British Standards Institution, 1998.

BS EN ISO 140-7:1998. Acoustics. Measurement of sound insulation in buildings and of building elements. Field measurements of impact sound insulation of floors. British Standards Institution, 1998.

BS EN ISO 140-18:2006. Acoustics. Measurement of sound insulation in buildings and of building elements. Laboratory measurement of sound generated by rainfall on building elements. British Standards Institution, 2006.

BS EN ISO 717-1:1997. Acoustics. Rating of sound insulation in buildings and of building elements. Airborne sound insulation. British Standards Institution, 1997.

BS EN ISO 717-2:1997. Acoustics. Rating of sound insulation in buildings and of building elements. Impact sound insulation. British Standards Institution, 1997.

BS EN ISO 11654:1997. Acoustics. Sound absorbers for use in buildings. Rating of sound absorption. British Standards Institution, 1997.

IEC 60849:1998. Sound systems for emergency purposes. International Electrotechnical Commission, 1998.

ISO 8253-1:1998. Acoustics. Audiometric test methods. Basic pure tone air and bone conduction threshold audiometry. International Organization for Standardization, 1998.

Department of Health publications

Health Technical Memorandum 03-01 – Specialised ventilation in healthcare premises. The Stationery Office, 2007.

Health Building Note 12 – ‘Out-patients department – Supplement 3: ENT and audiology clinics, hearing aid centre’.

Health Technical Memorandum 08-03 – ‘Bedhead services’.

Other publications

Association of Noise Consultants (ANC). Guidelines on noise measurement in buildings. ANC, 1997.

United Kingdom Accreditation Service (UKAS).

Table 5 Matrix showing sound-insulation performance required (dB $D_{nT,w}$)

Source room	Receiving room																																											
	Clinical areas																	Public areas						Staff areas																				
	Single-bed/on-call room	Multi-bed room	Children & older people (single bed)	Children & older people (multi-bed)	Consulting room	Examination room	Treatment room	Counselling/bereavement room	Interview room	Operating theatre suite	Nurseries	Birthing room	Laboratories	Dirty utility/sluite	Clean utility	Speech and language therapy	Snoezelen/multi-sensory room	Multi-faith/chapel	Corridor (no door)	Atrium	Dining	Toilets (not cubicles)	Waiting (large >20 people)	Waiting (small ≤20 people)	Toilets (not cubicles)	Main kitchen	Ward kitchen, pantry	Storeroom	Rest room	Locker/changing room	Large training/seminar (>35 m²)	Small training/seminar (≤35 m²)	Lecture theatre	Library/archiving room	Single-person office	Multi-person office (2–4 people)	Open-plan office (≥5 people)	Boardroom	Large meeting room (>35 m²)	Small meeting room (≤35 m²)				
Clinical areas																																												
Single-bed/on-call room	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47		
Multi-bed room	37	37	37	37	37	37	37	37	37	42	42	37	37	37	37	37	37	42	37	37	37	37	37	37	37	37	37	37	37	37	37	37	42	42	37	37	37	37	37	37	37	37		
Children & older people (single bed)	47	47	47	47	47	47	47	47	47	52	47	47	47	42	42	52	52	52	42	42	42	42	42	42	42	42	42	42	42	42	47	42	47	52	52	47	47	47	47	47	47	47	47	
Children & older people (multi-bed)	42	42	42	42	42	42	42	42	42	47	42	42	42	37	37	47	47	47	37	37	37	37	37	37	37	37	37	37	37	42	37	42	42	47	47	42	42	42	42	42	42	42	42	
Consulting room	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	
Examination room	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	
Treatment room	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	
Counselling/bereavement room	47	47	47	47	47	47	47	47	47	52	47	47	47	47	47	52	52	52	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	52	52	47	47	47	47	47	47	47	47	47
Interview room	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47
Operating theatre suite	42	42	42	42	42	42	42	42	42	47	42	42	42	42	42	47	47	47	42	42	42	42	42	42	42	42	42	42	42	42	42	42	42	47	47	42	42	42	42	42	42	42	42	42
Nurseries	52	52	52	52	52	52	52	52	52	★	52	52	52	47	47	★	★	★	47	47	47	47	47	47	47	47	47	47	47	52	47	52	52	★	★	52	52	52	52	52	52	52	52	
Birthing room	52	52	52	52	52	52	52	52	52	★	52	52	52	47	47	★	★	★	47	47	47	47	47	47	47	47	47	47	47	52	47	52	52	★	★	52	52	52	52	52	52	52	52	
Laboratories	37	37	37	37	37	37	37	37	37	42	37	37	37	37	37	42	42	42	37	37	37	37	37	37	37	37	37	37	37	37	37	37	42	42	37	37	37	37	37	37	37	37	37	
Dirty utility/sluite	42	42	42	42	42	42	42	42	42	47	42	42	42	n/a	n/a	47	47	47	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	42	42	47	47	42	42	42	42	42	42	42	42	
Clean utility	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	37	n/a	n/a	n/a	n/a	n/a	37	37	37	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	37	37	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	
Speech and language therapy	47	47	47	47	47	47	47	47	47	52	47	47	47	47	47	52	52	52	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	52	52	47	47	47	47	47	47	47	47	
Snoezelen/multi-sensory room	47	47	47	47	47	47	47	47	47	52	47	47	47	47	47	52	52	52	47	47	47	47	47	47	47	47	47	47	47	47	47	47	47	52	52	47	47	47	47	47	47	47	47	
Public areas																																												
Multi-faith/chapel	47	47	47	47	47	47	47	47	47	52	47	47	47	42	42	52	52	52	42	42	42	42	42	42	42	42	42	42	47	42	47	47	52	52	47	47	47	47	47	47	47	47	47	
Corridor (no door)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	n/a	n/a	n/a	n/a	42	42	42	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	42	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	
Atrium	42	42	42	42	42	42	42	42	42	47	42	42	42	n/a	n/a	47	47	47	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	42	42	47	47	42	42	42	42	42	42	42	42	42	
Dining	42	42	42	42	42	42	42	42	42	47	42	42	42	n/a	n/a	47	47	47	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	42	42	47	47	42	42	42	42	42	42	42	42	42	
Toilets (not cubicles)	37	37	37	37	37	37	37	37	37	42	37	37	37	37	37	42	42	42	37	37	37	37	37	37	37	37	37	37	37	37	37	37	42	42	37	37	37	37	37	37	37	37		
Waiting (large >20 people)	42	42	42	42	42	42	42	42	42	47	42	42	42	n/a	n/a	47	47	47	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	42	42	47	47	42	42	42	42	42	42	42	42	42	
Waiting (small ≤20 people)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	42	42	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	42	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a		
Staff areas																																												
Toilets (not cubicles)	37	37	37	37	37	37	37	37	37	42	37	37	37	37	37	42	42	42	37	37	37	37	37	37	37	37	37	37	37	37	37	37	42	42	37	37	37	37	37	37	37	37		
Main kitchen	52	52	52	52	52	52	52	52	52	★	52	52	52	47	47	★	★	★	47	47	47	47	47	47	47	47	47	47	52	47	52	52	★	★	52	52	52	52	52	52	52	52		
Ward kitchen, pantry	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	42	n/a	n/a	n/a	n/a	n/a																													